


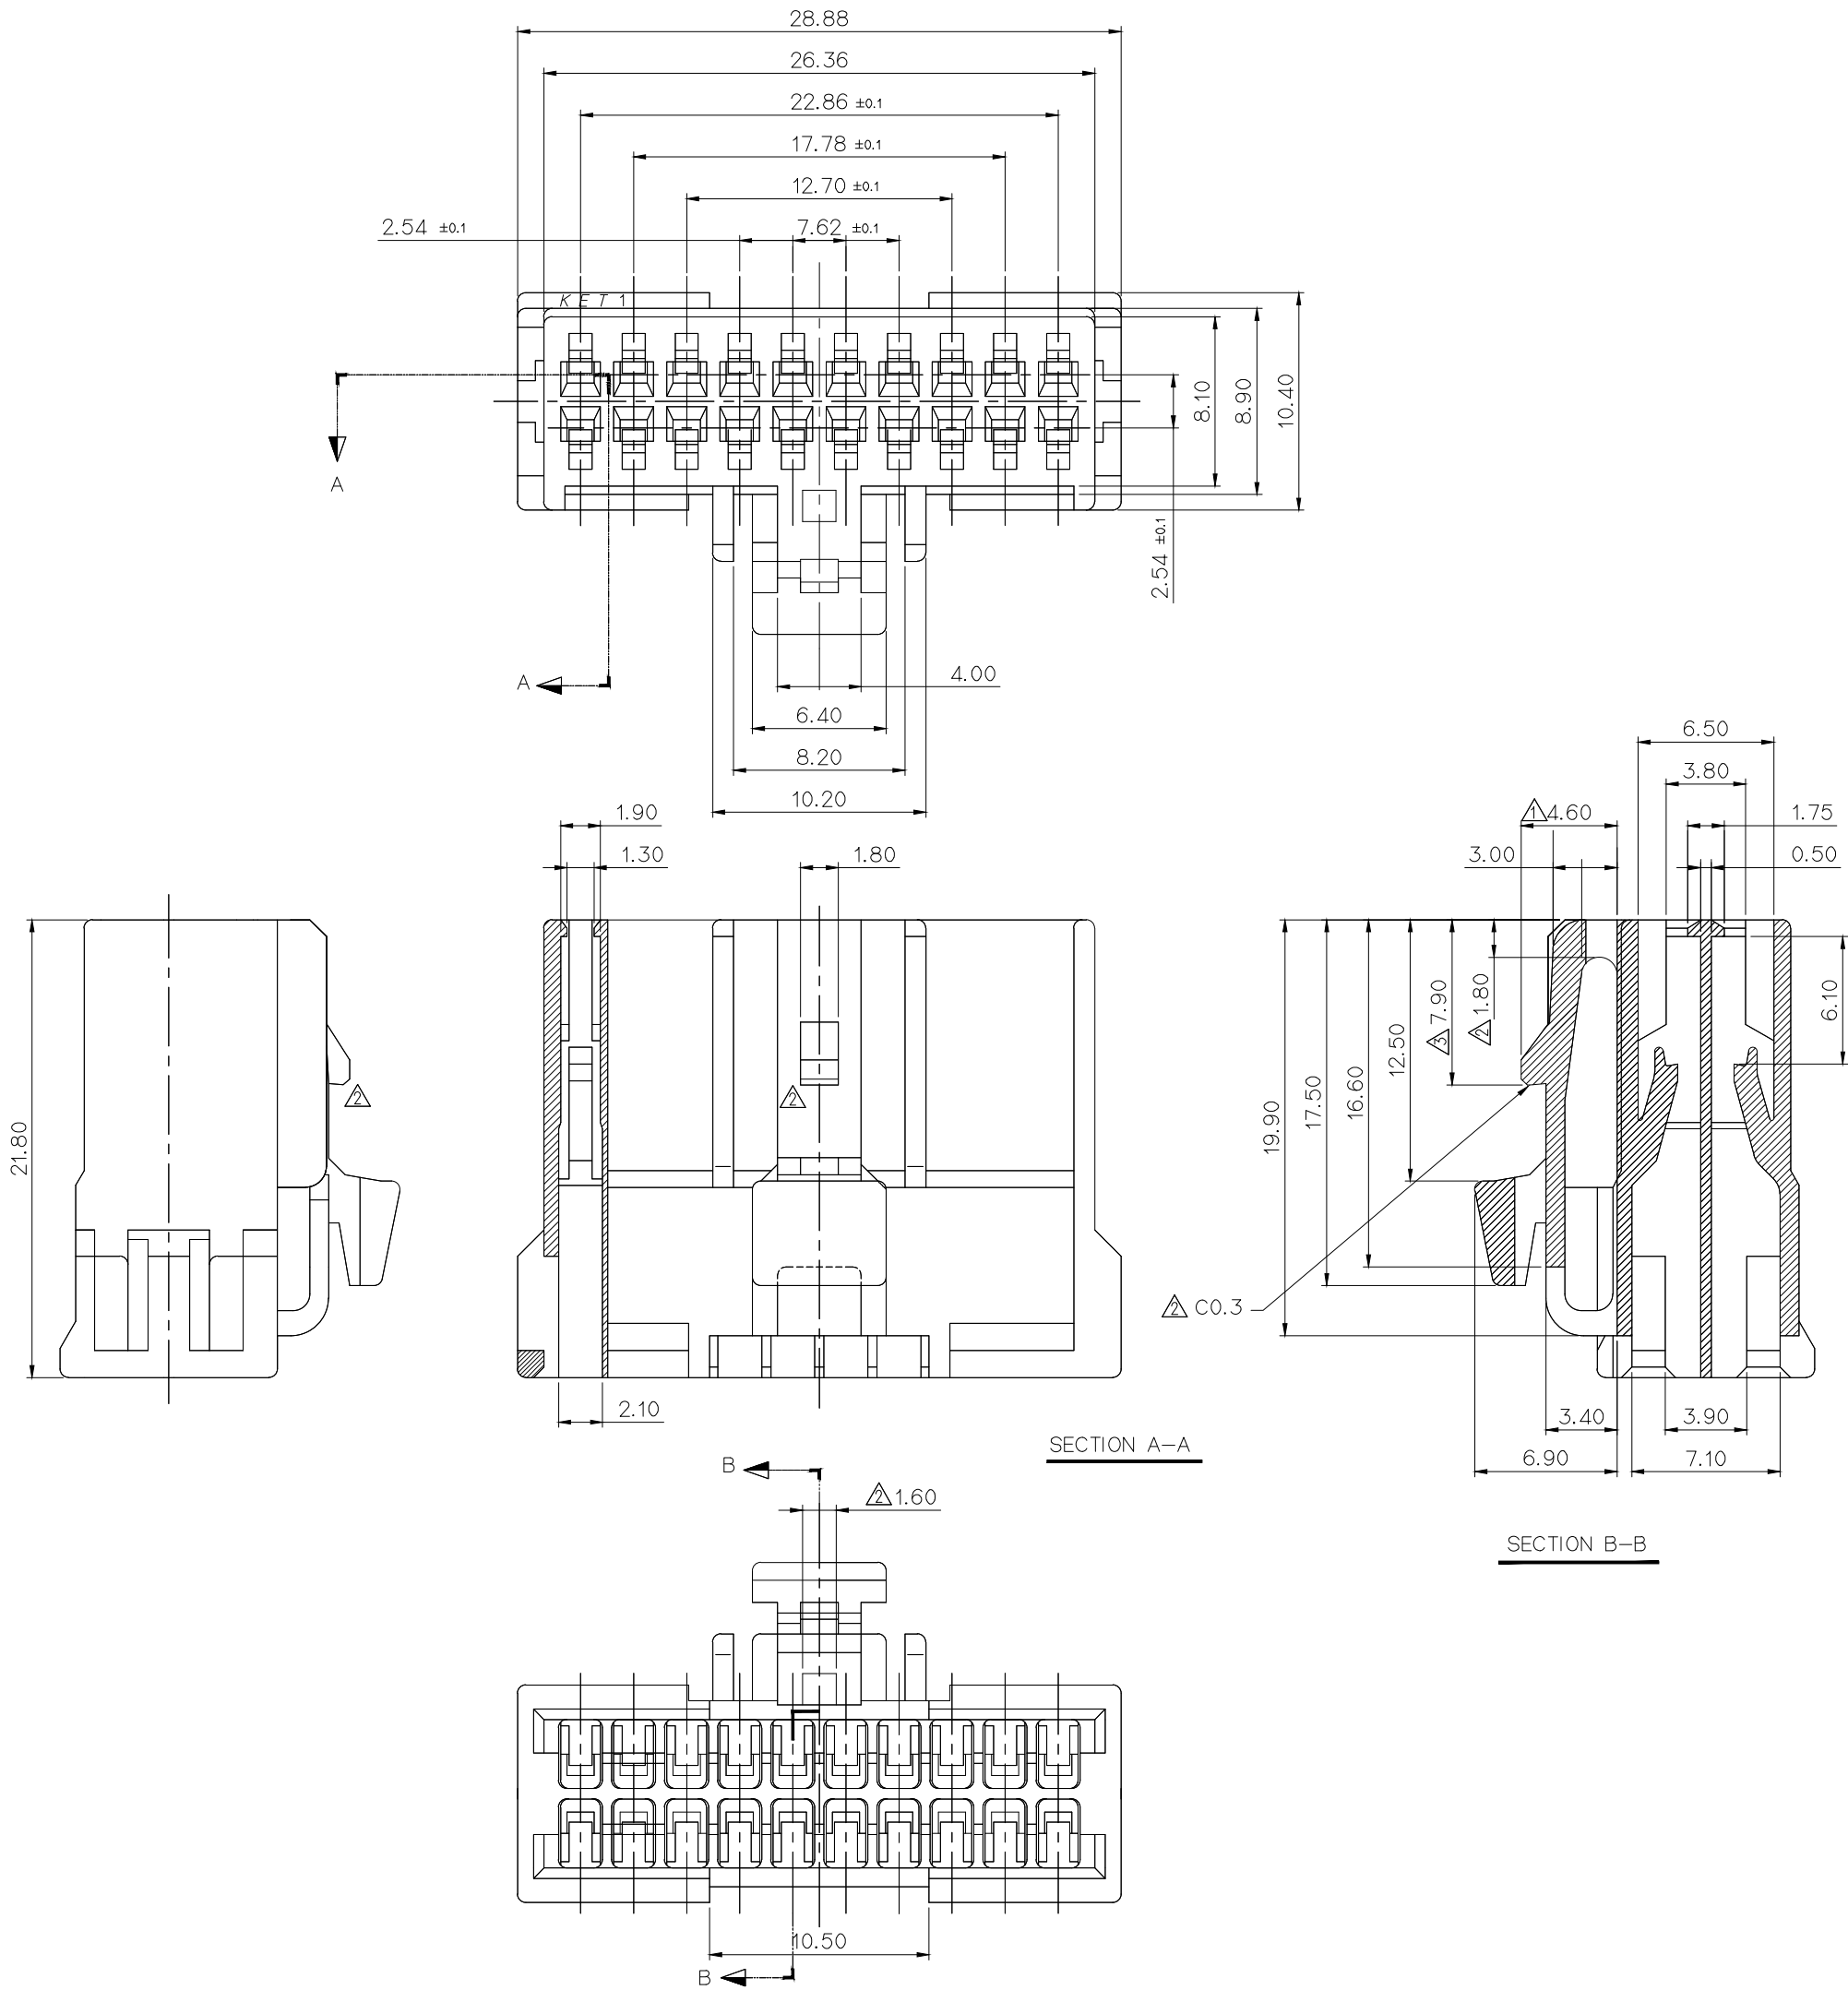

| GENERAL TOLERANCE (HOUSING) |        |         |         |        |       |        | USED ON |
|-----------------------------|--------|---------|---------|--------|-------|--------|---------|
| 10 MAX                      | 50 MAX | 100 MAX | 250 MAX | 250 VR | ANGLE | ECCENT |         |
| ±0.2                        | ±0.3   | ±0.55   | ±0.95   | ±1.4   | ±30'  | 0.1    |         |

| NO. | MATERIAL | COLOR       |
|-----|----------|-------------|
| 0   | NYLON66  | NATURAL     |
| 1   |          | RED         |
| 2   |          | BLUE        |
| 3   |          | YELLOW      |
| 40  |          | DARK GRAY   |
| 41  |          | LIGHT GRAY  |
| 5   |          | BLACK       |
| 6   |          | DARK GREEN  |
| 7   |          | BROWN       |
| 8   |          | LIGHT GREEN |
| 9   |          | MAGENTA     |
| 11  |          | ORANGE      |

주 기

- 지시없는 ROUND는 전부 0.4로 할 것.
- 기능상 유해한 BURR 및 변형이 없을 것.
- 적용 FEMALE TERMINAL : ST730517-3
- 적용 MATCHING HOUSING : MG640391(VRT)/MG640380(HZT)
- 적용 REAR HOLDER : MG630365-3 (2EA)

NOTE

- UNLESS OTHERWISE SPECIFIED ALL RADIUS TO BE 0.4 RADIUS.
- MUST BE FREE OF FLASH, SINK AND IMPERFECTION THAT AFFECT FUNCTION.
- APPLICABLE FEMALE TERMINAL : ST730517-3
- APPLICABLE MATCHING HOUSING : MG640391(VRT)/MG640380(HZT)
- APPLICABLE REAR HOLDER : MG630365-3 (2EA)

APPROVED

2020-12-24

KOREA ELECTRIC  
TERMINAL CO., LTD.  
Korea Electric Te  
rminal Co., LTD.

ISSUE MARK

|              |                                       |                          |             |           |            |                                 |                                                                                        |           |          |
|--------------|---------------------------------------|--------------------------|-------------|-----------|------------|---------------------------------|----------------------------------------------------------------------------------------|-----------|----------|
| <div>④</div> | ECO-2009-0930에 근거 도면 재작성<br>도면 추가한 변경 | KJH<br>NKT               | SSH         | '20.09.07 | MATERIAL   | SEE TABLE                       | <div>KIET</div> <div>ENGINEERED</div> <div>KOREA ELECTRIC<br/>TERMINAL CO., LTD.</div> |           |          |
|              | <div>③</div>                          | ECO-1301-0150에 근거 도면 재작성 | YM.K<br>CSH | HSH       | '13.01.04  | FINISH                          |                                                                                        | SEE TABLE |          |
| <div>②</div> | 시방변경(S050110)근거 수정                    | KYM                      |             | '05.05.16 | WIRE RANGE |                                 | CLASS                                                                                  | SP        |          |
| <div>①</div> | LOCK 강도 보강 수정                         | WON                      |             | '99.07.14 | INSULATION |                                 | TYPE                                                                                   | 7123-1403 |          |
| LTR          | REVISION RECORD                       | DR.                      | CHK.        | APP.      | DATE       | TOLERANCE<br>EXCEPT<br>AS NOTED | SCALE<br>4/1                                                                           | PART NO.  | MG610363 |
| DR.          | RH0 92.08.24                          | CHK.                     |             |           |            | PART NAME<br>SP 20F HOUSING     |                                                                                        |           |          |
| CHK.         | S. W. K                               | APP.                     |             |           |            |                                 |                                                                                        |           |          |