

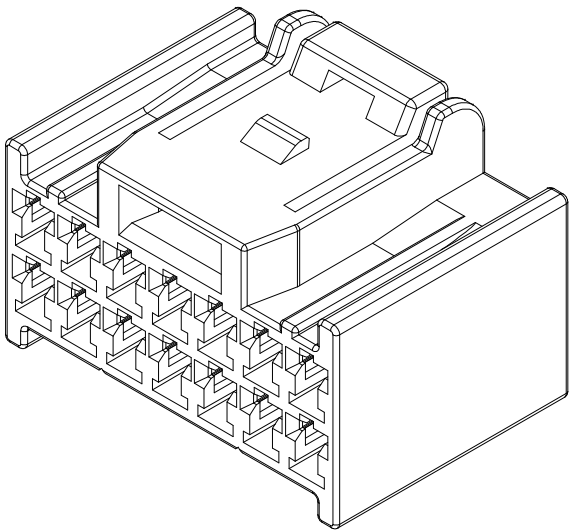
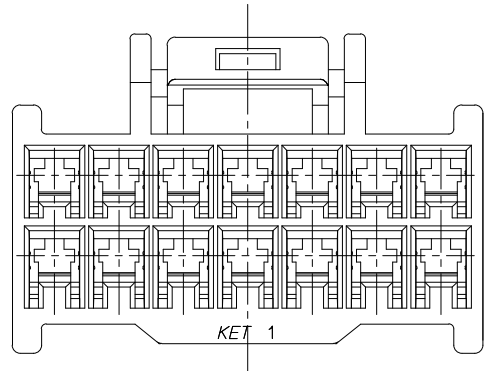
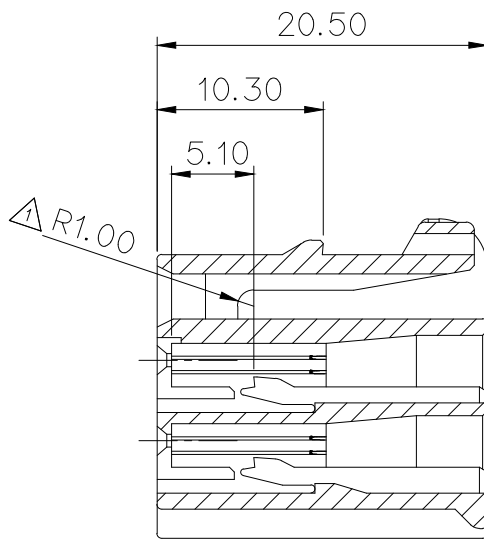
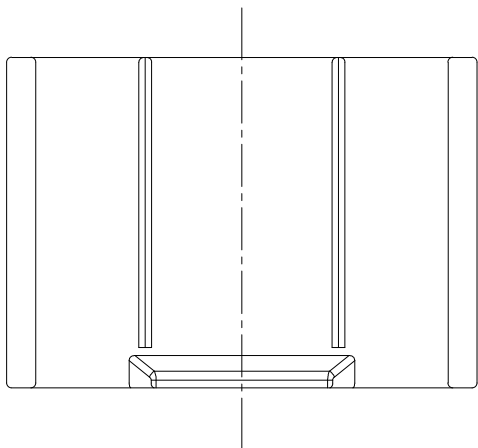
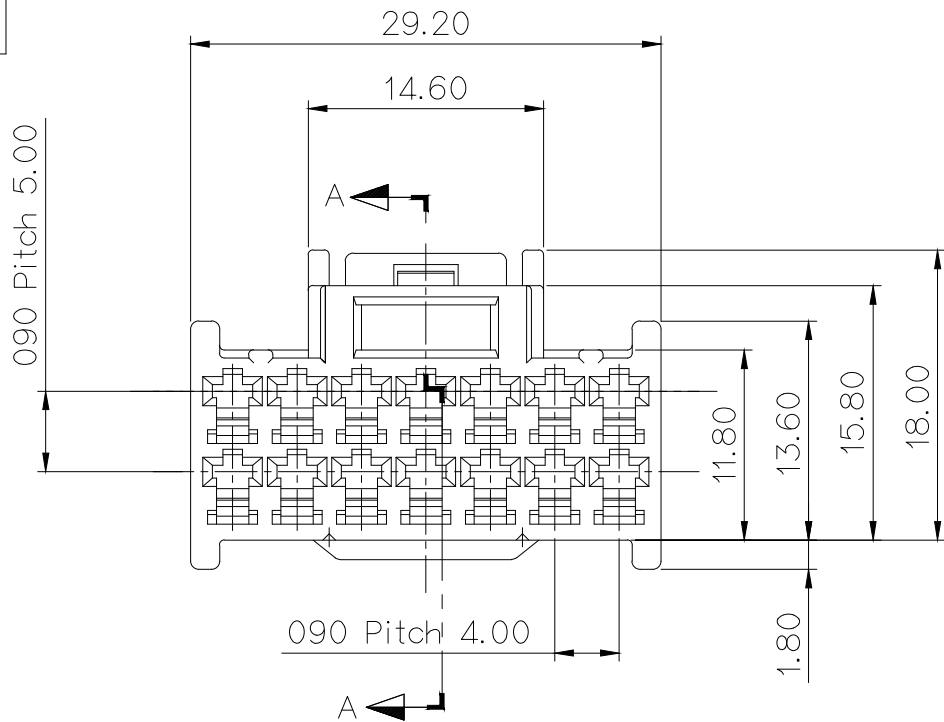


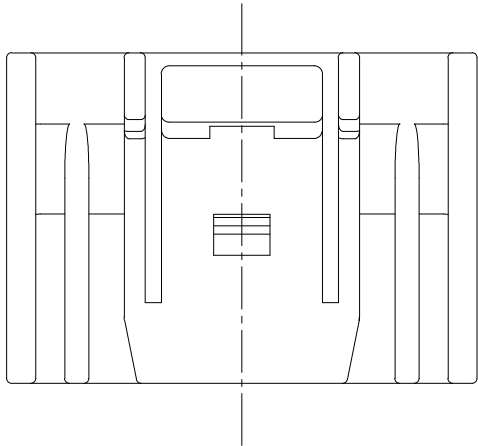

ISO VIEW

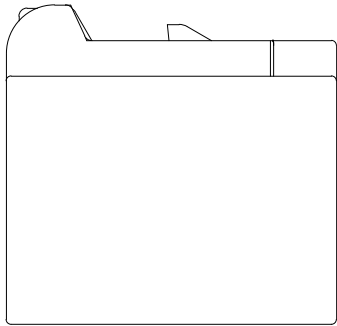

GENERAL TOLERANCE (HOUSING)							USED ON
10MAX	50MAX	100MAX	250MAX	250VR	ANGLE	ECCENT	
±0.2	±0.3	±0.55	±0.95	±1.4	±30'	0.1	

NOTE

- MUST BE FREE OF BURR, WELDLINE AND IMPERFECTION THAT AFFECT FUNCTION.
- APPLICABLE TERMINAL : ST731148, 1149, 1150, 1151
APPLICABLE CONNECTOR : MG624336
- 6 HAZARDOUS SUBSTANCES IN PARTS (LEAD, MERCURY, CADMIUM, HEXAVALENT CHROMIUM, PBBs, PBDEs) SHALL NOT EXCEED THE MAXIMUM PERMISSIBLE CONCENTRATION PRESCRIBED UNDER EU ELV DIRECTIVE & RoHS REGULATION.

주 기

- 기능상 유해한 BURR 및 WELDLINE등이 없을것.
- 적용 TERMINAL : ST731148, 1149, 1150, 1151
적용 CONNECTOR : MG624336
- 제품내 함유된 6대 유해물질 (납, 수은, 카드뮴, 6가크롬, PBBs, PBDEs)은 EU ELV 지침 및 RoHS 법규에서 지정한 최대 허용 농도를 초과해서는 안된다.

					MATERIAL PBT		 KOREA ELECTRIC TERMINAL CO., LTD.
					FINISH NATURAL		
					WIRE RANGE		
					INSULATION		
	ECO-1107-023 근거 형상 변경	SHS	JYS	KKJ	'11.07.04	CLASS 090	
LTR	REVISION RECORD	DR.	CHK.	APP.	DATE	TOLERANCE EXCEPT AS NOTED SEE TABLE	SCALE 2/1
DR. CDH 10.05.27		CHK. JYS	05.27		PART NO. MG614335		
CHK.		APP. KKJ	05.27		PART NAME 090 DTC 14F HOUSING		

APPROVED

2018-12-07

KOREA ELECTRIC
TERMINAL CO., LTD.
Product Development Team 1

ISSUE MARK