
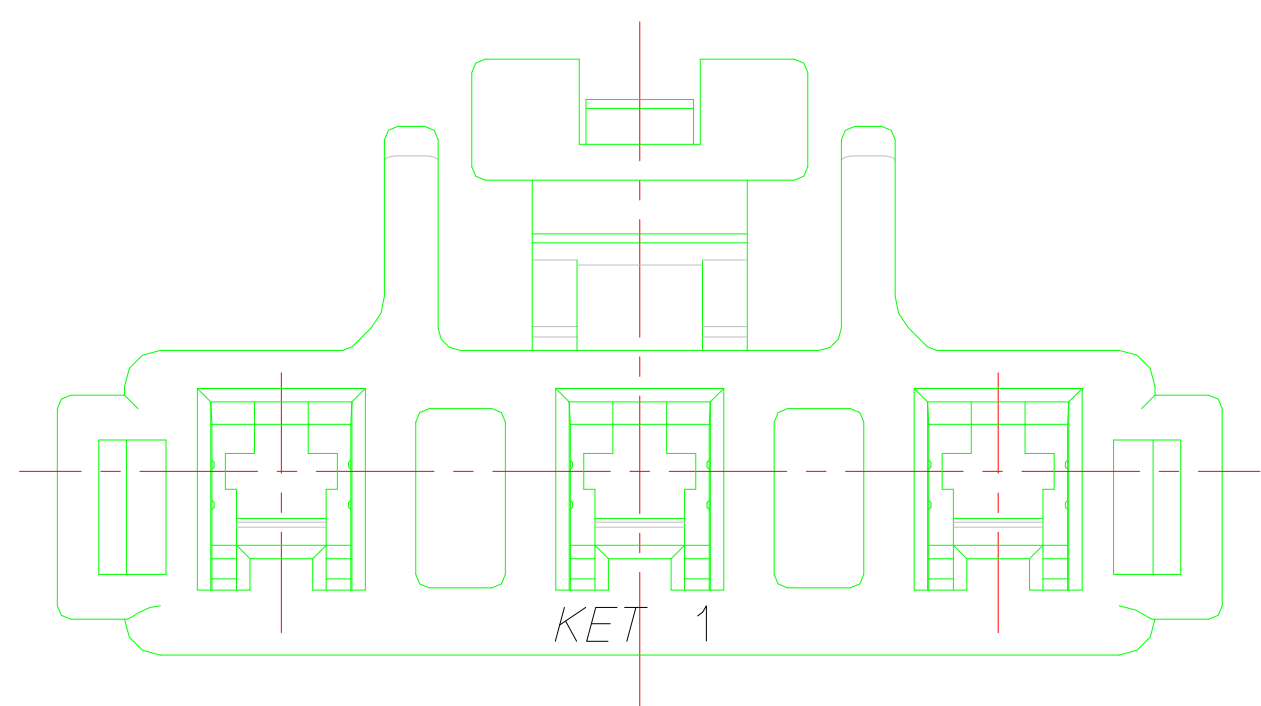
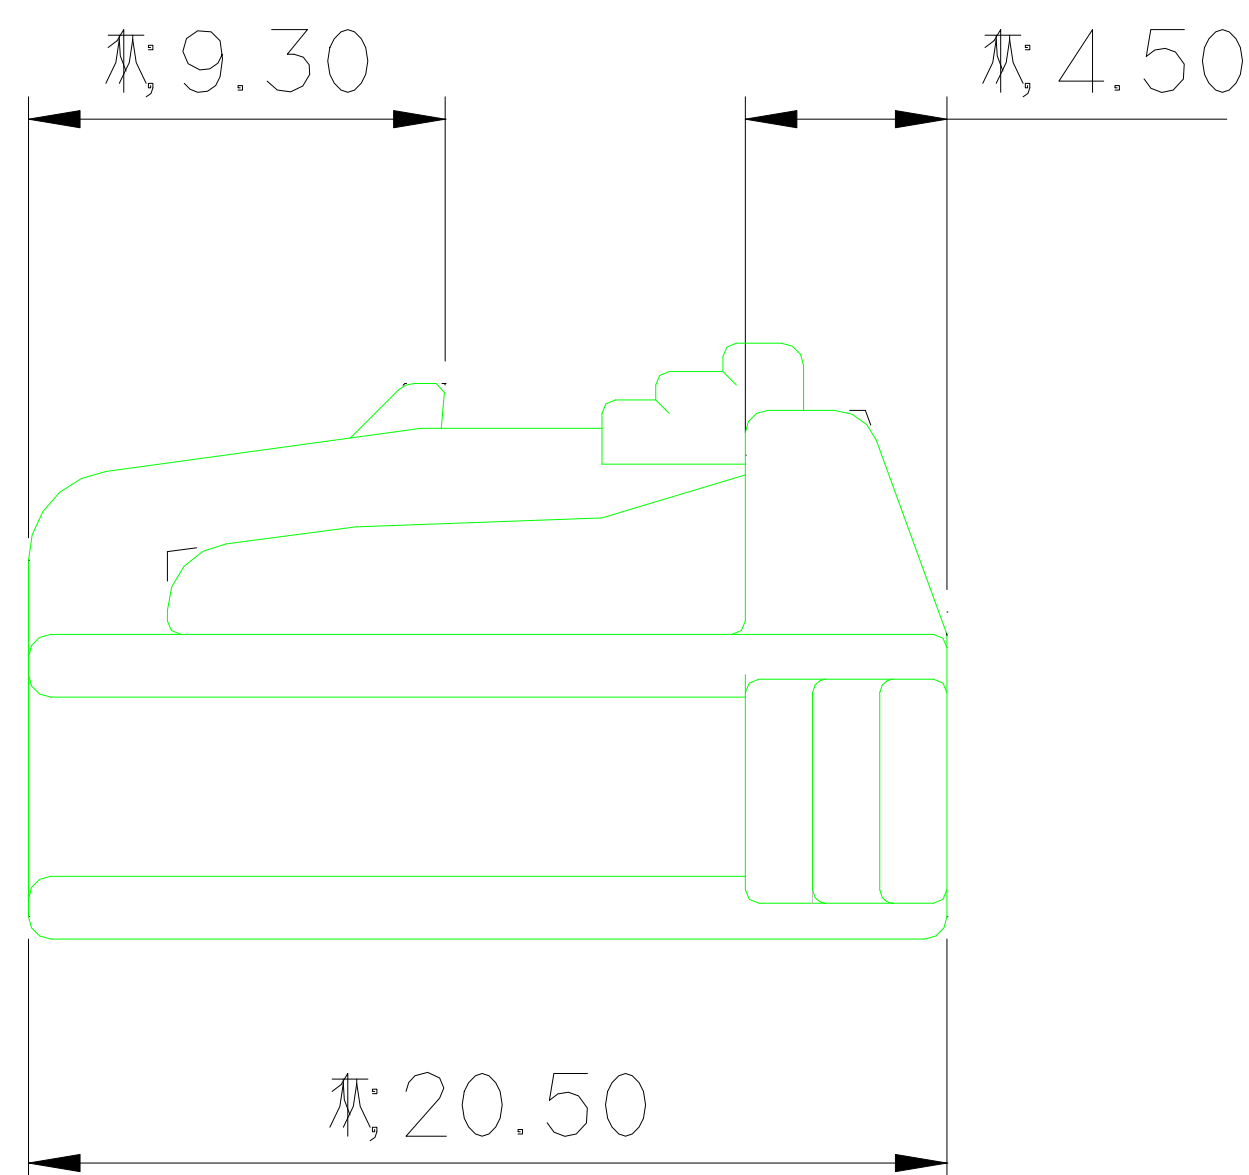
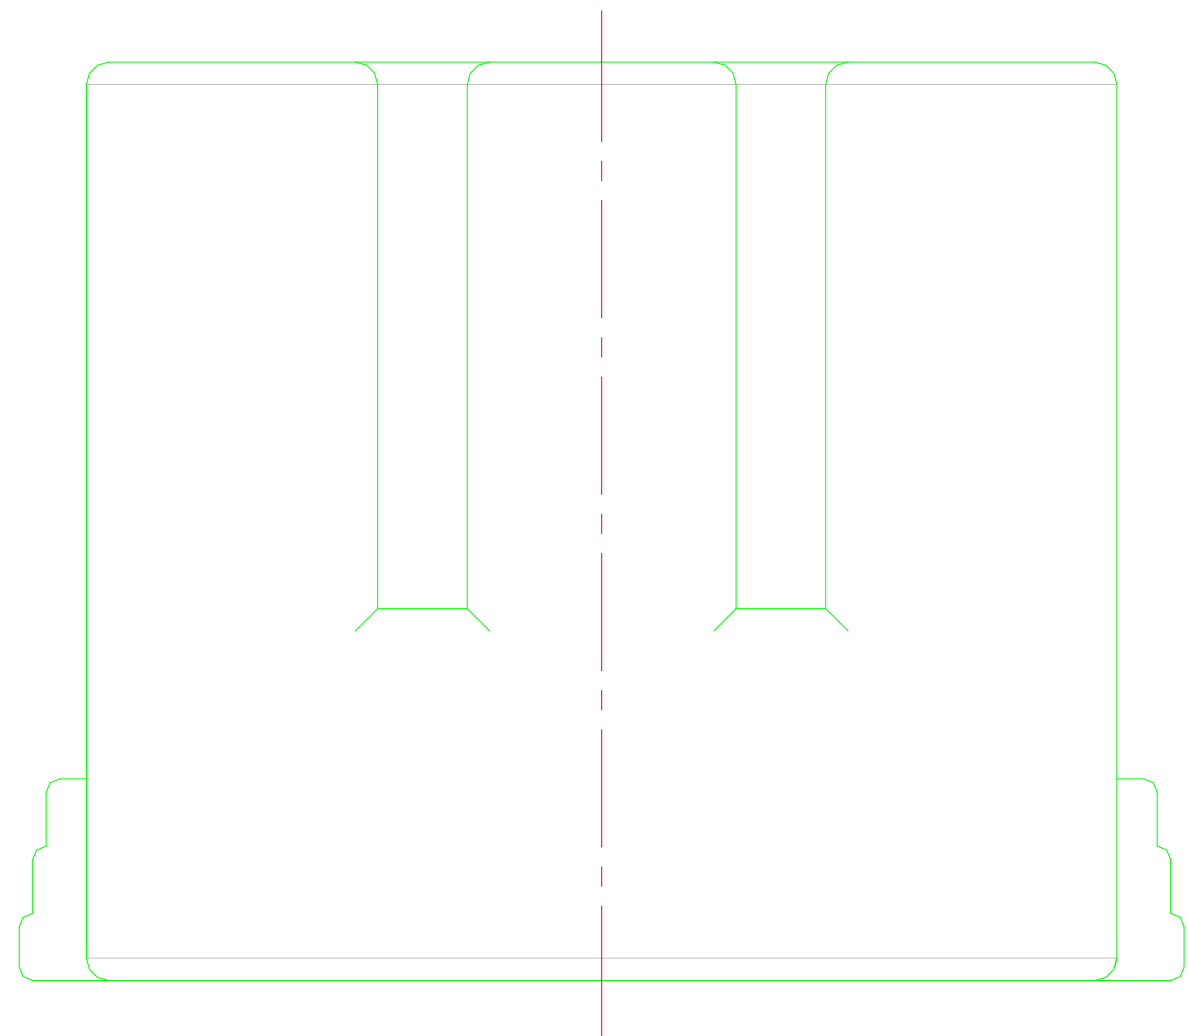
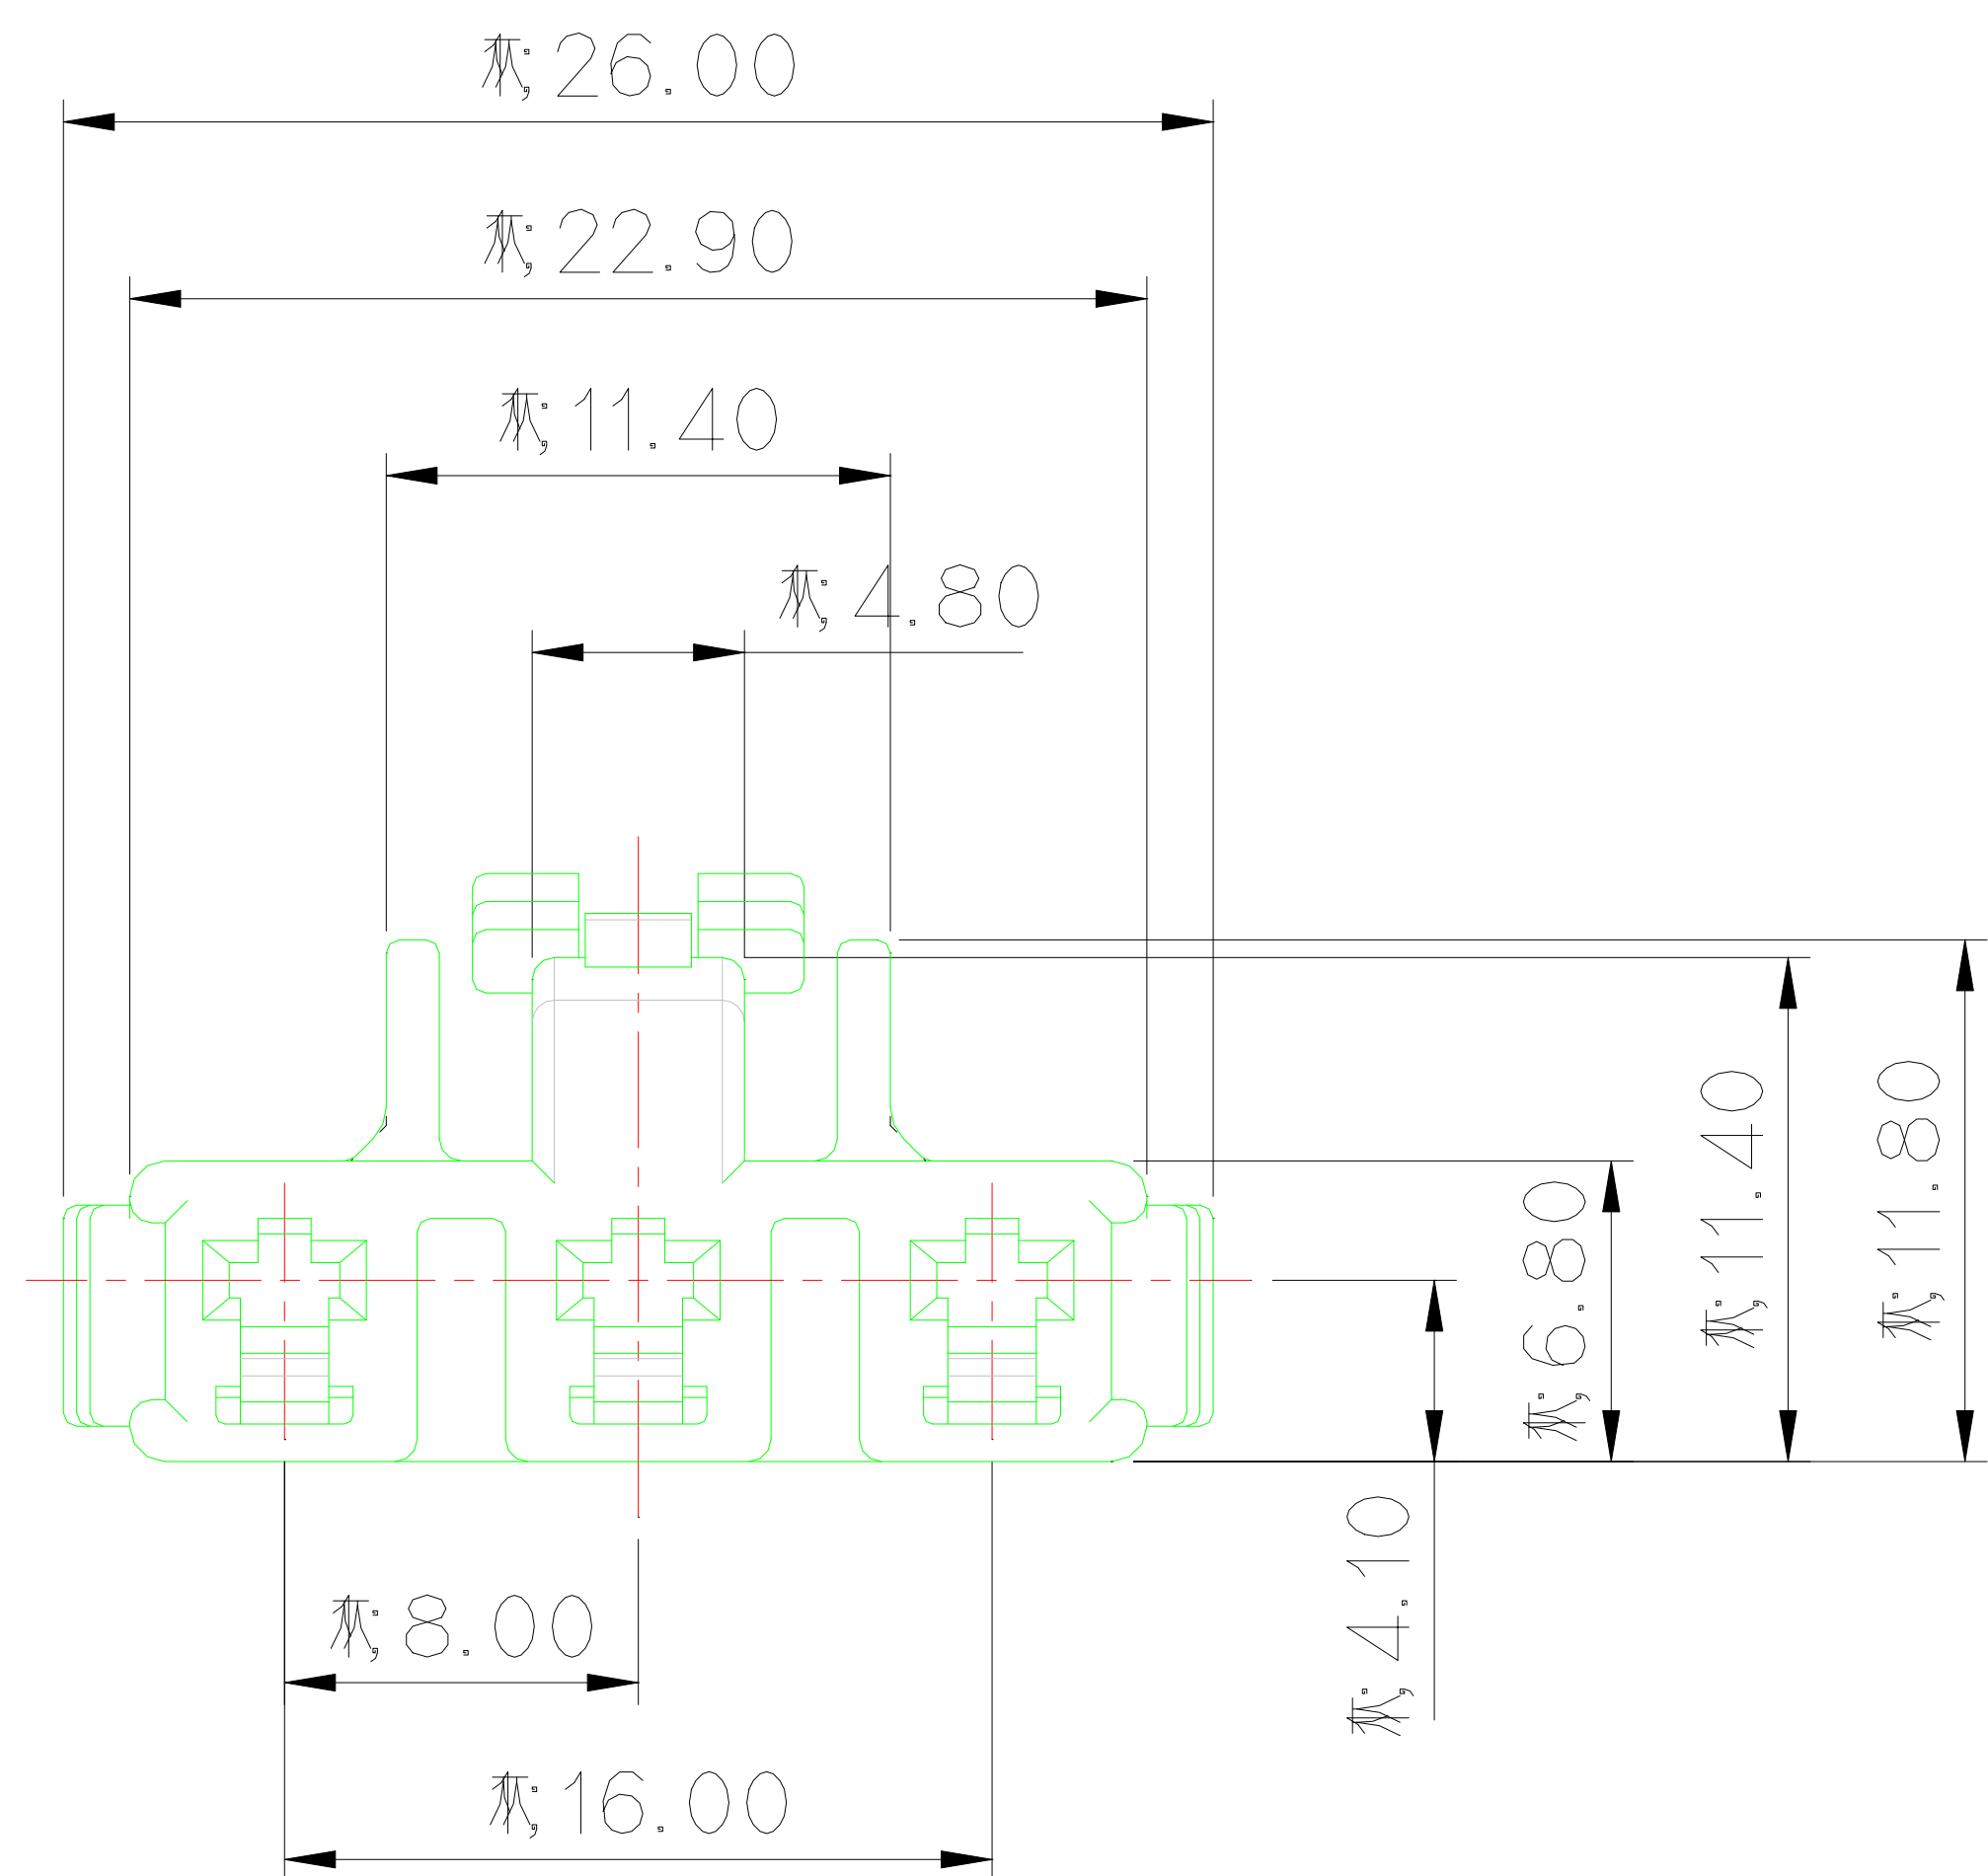
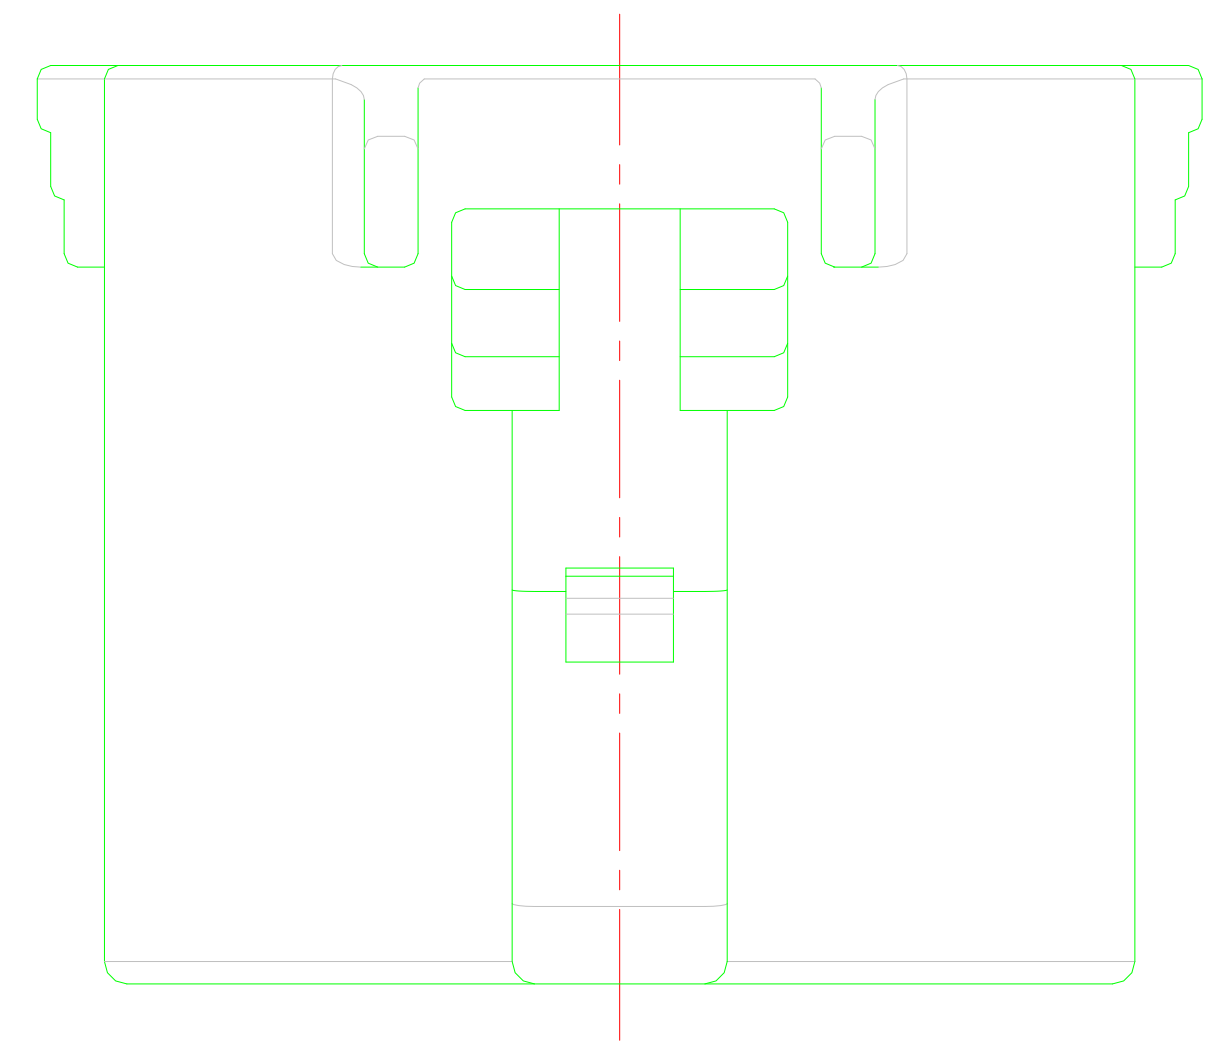


ISO VIEW

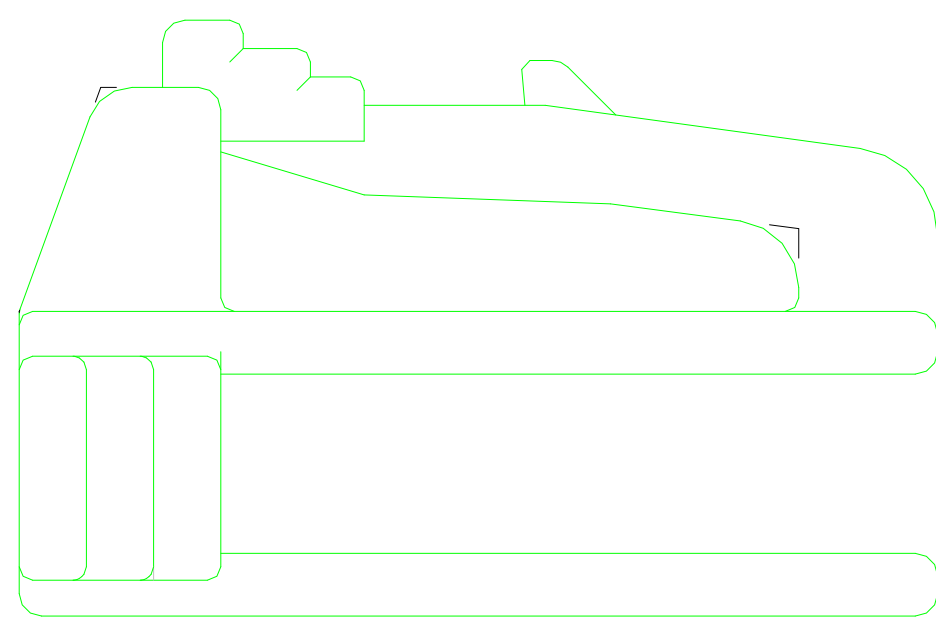

GENERAL TOLERANCE (HOUSING)

10MAX	50MAX	100MAX	250MAX	250VR	ANGLE	ECCENT	USED ON
±0.2	±0.3	±0.55	±0.95	±1.4	±30'	0.1	


NOTE

1. UNLESS OTHERWISE SPECIFIED ALL RADIUS TO BE 0.3 RADIUS.
2. UNLESS OTHERWISE SPECIFIED ALL CHAMFERS TO BE 0.3 CHAMFER.
3. APPLICABLE TERMINAL : ST731100, 0675, 0676, 0677
4. 6 HAZARDOUS SUBSTANCES IN PARTS (LEAD, MERCURY, CADMIUM, HEXAVALENT CHROMIUM, PBBs, PBDEs) SHALL NOT EXCEED THE MAXIMUM PERMISSIBLE CONCENTRATION PRESCRIBED UNDER EU ELV DIRECTIVE & RoHS REGULATION.

주 기

- 1.지시하지 않은 반경 R은 0.3로 한다
- 2.지시하지 않은 모따기 C는 0.3으로 한다.
- 3.적용 TERMINAL : ST731100, 0675, 0676, 0677
- 4.제품내 함유된 6대 유해물질 (납, 수은, 카드뮴, 6가크롬, PBBs, PBDEs)은 EU ELV 지침 및 RoHS 법규에서 지정한 최대 허용 농도를 초과해서는 안된다.

ISSUE MARK

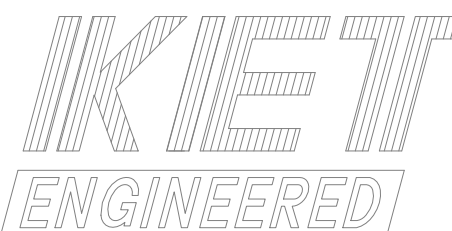						MATERIAL	PBT		KOREA ELECTRIC TERMINAL CO.,LTD		
						FINISH	NATURAL				
						WIRE RANGE				CLASS	090
						INSULATION				TYPE	090II
LTR	REVISION RECORD		DR.	CHK.	APP.	DATE	TOLERANCE EXCEPT AS NOTED	SCALE 1/1	PART NO.	MG615539	
DR.		JUNG.Y.S	2011.02.18		CHK.		PART NAME 090II 3F HOUSING (FUEL PUMP용)				
CHK.				APP.		KKJ					2011.02.18