
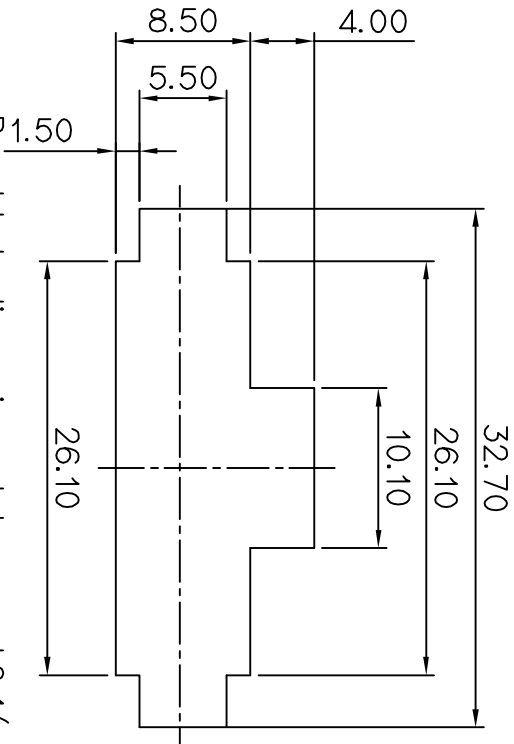
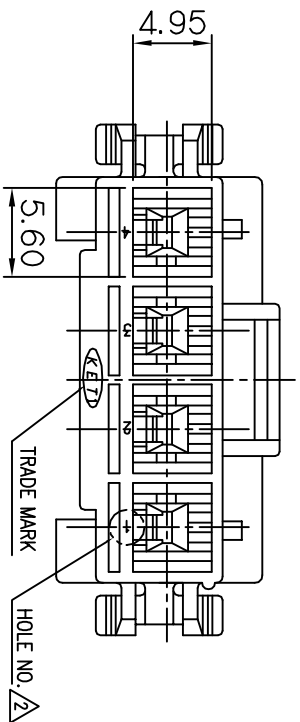
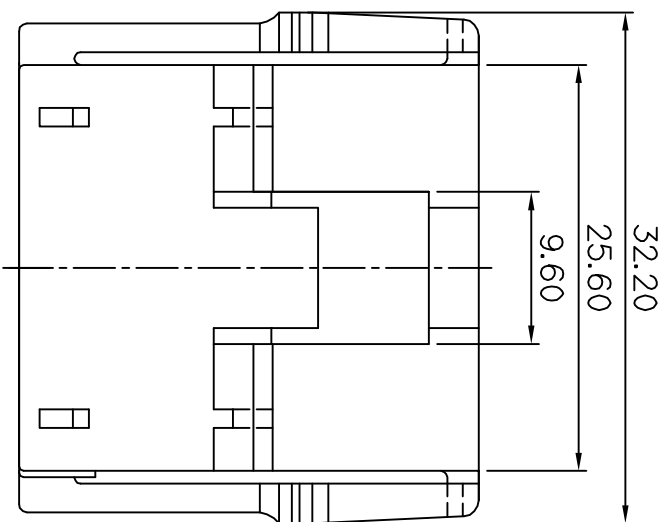
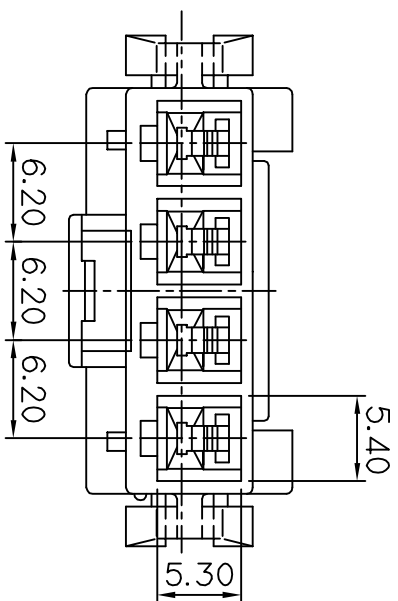


Panel hole dimensions tolerance ± 0.1 (mm)



(Applicable panel thickness : 0.8 ~ 2.4 mm)

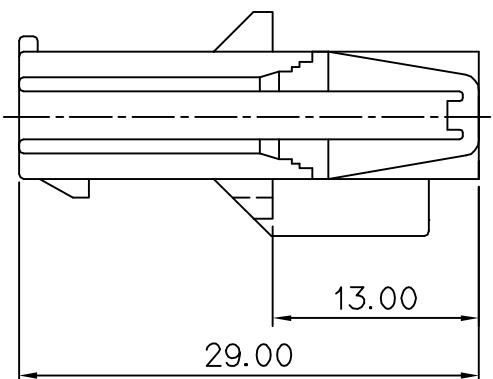

GENERAL TOLERANCE (HOUSING)						USED ON
10 MAX	50 MAX	100 MAX	250 MAX	250 VR	ANGLE	ECCENT
±0.2	±0.3	±0.55	±0.95	±1.4	±30'	0.1

NOTE

1. MUST BE FREE OF FLASH, SINK, WELDLINE AND IMPERFECTION THAT AFFECT FUNCTION.
2. APPLICABLE TERMINAL : ST740690,691,692,693,871-3
3. APPLICABLE HOUSING : MG611169
4. APPLICABLE R/HOLDER : MG631171-2
5. 6 HAZARDOUS SUBSTANCES IN PARTS (LEAD,MERCURY, CADMIUM,HEXAVALENT CHROMIUM,PBBs,PBDEs) SHALL NOT EXCEED THE MAXIMUM PERMISSIBLE CONCENTRATION PRESCRIBED UNDER EU ELV DIRECTIVE & RoHS REGULATION.

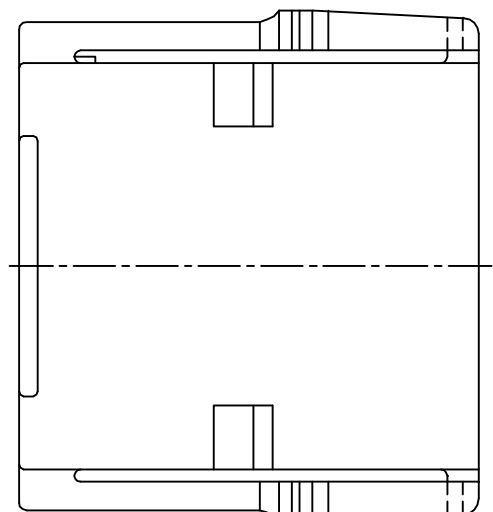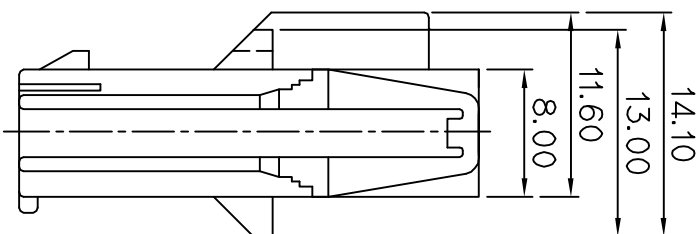

주 기

- 1.기동상 유해한 FLASH, SINK,WELDLINE 등이 없음것.
- 2.적용 TERMINAL: ST740690,691,692,693,871-3
- 3.적용 HOUSING: MG611169
- 4.적용 R/HOLDER: MG631171-2
- 5.제품내 함유된 6대 유해물질 (납,수은,카드뮴,6가크롬, PBBs,PBDEs)은 EU ELV 지침 및 RoHS 법규에서
지정된 최대 허용 농도를 초과해서는 안된다.

ISSUE MARK

			MATERIAL	PBT (VO)	KIET KOREA ELECTRIC [ENGINEERED] TERMINAL CO., LTD.
			FINISH	NATURAL	
			WIRE RANGE	CLASS	
			INSULATION	TYPE	
			TOLERANCE EXCEPT AS NOTED	SAMPLE SCALE	
			PART NAME	PART NO.	
D:\sign\mk.jpg	7/22	APP.	D:\sign\app-08F	7/22	1806 D/L 4P REC. HS'G
DR.	KO	96.07.16	CHK.	7/22	MG621175
L7R	REVISION RECORD	DR.	CHK.	APP.	DATE
①	설치시공변경시 S110128 전기 도면제작성	KSH			11.04.29
②	ECC-1109-234에 약기 도면 제작성	이정호		이정호	11.09.29