



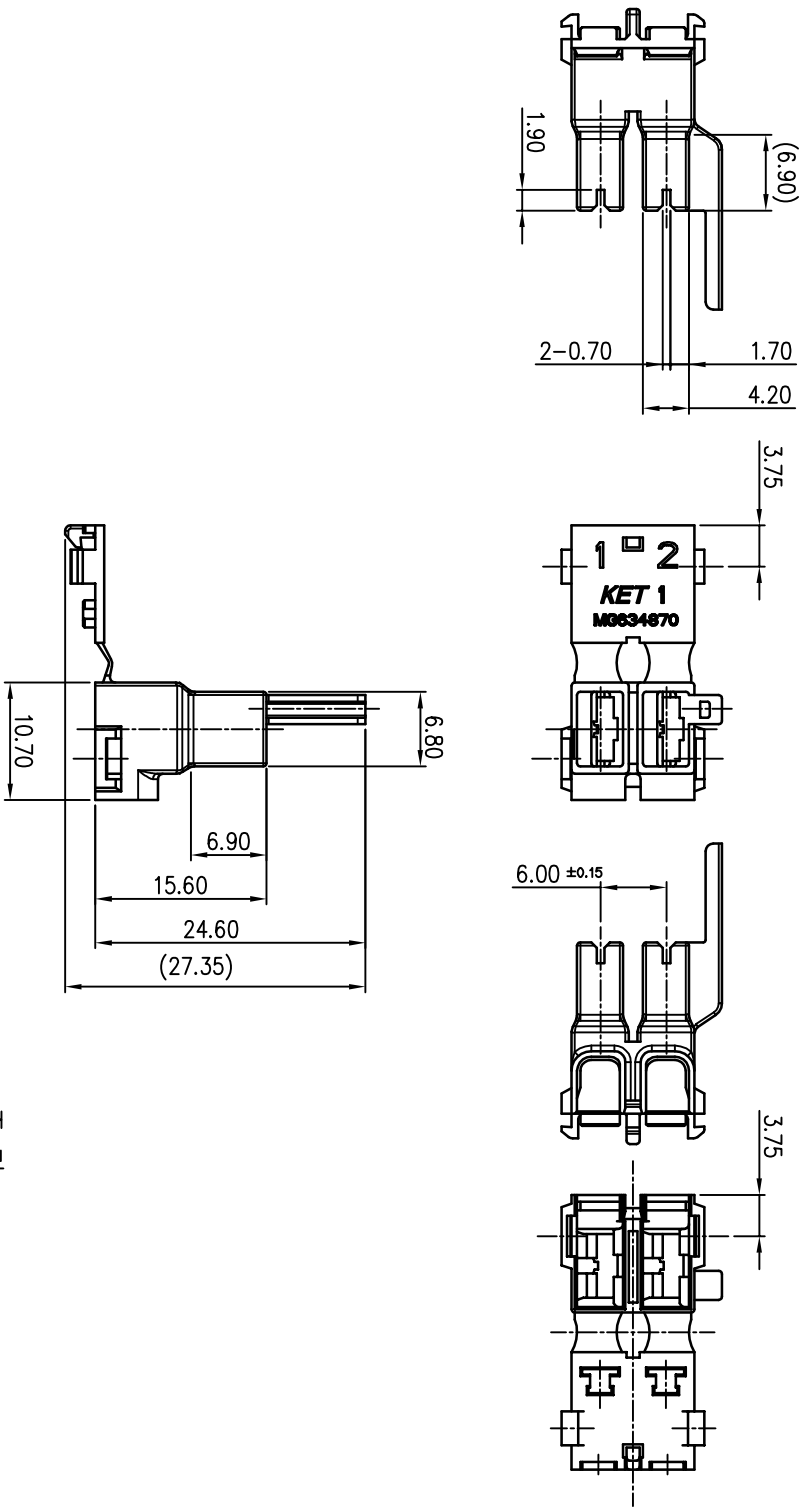

NOTE

- 1. MUST BE FREE OF BURR, WELDLINE AND IMPERFECTION THAT AFFECT FUNCTION.
- 2. APPLICABLE TERMINAL : ST731079-3
- 3. 6HAZARDOUS SUBSTANCES IN PARTS (Lead, Mercury, Cadmium, Hexavalent Chromium, PBBs, PBDEs) SHALL NOT EXCEED THE MAXIMUM PERMISSIBLE CONCENTRATION PRESCRIBED UNDER EU ELV DIRECTIVE & ROHS REGULATION

GENERAL TOLERANCE (HOUSING)					USED ON
10MAX	20MAX	45MAX	ANGLE	ECCENT	
±0.2	±0.25	±0.3	±30'	0.1	

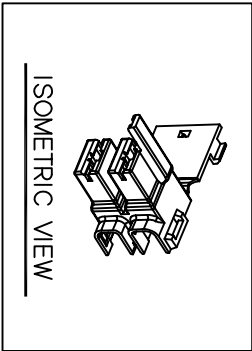

ISOMETRIC VIEW

주 기

- 1. 기능상 유해한 BURR 및 WELDLINE등이 없음것.
- 2. 적용 터미널 : ST731079-3
- 3. 제품 내 함유된 6대 유해물질 (납, 수은, 카드뮴, 6가 크롬 PBBs, PBDEs)은 EU ELV 지침 및 RoHS 법규에서 지정한 최대 허용농도를 초과해서는 안 된다.

ISSUE MARK

							MATERIAL	PA66 (V0)	KET KOREA ELECTRIC [ENGINEERED] TERMINAL CO., LTD.
							FINISH	NATURAL	
							WIRE RANGE		
							INSULATION		
							SCALE	2/1	
LTR	REVISION RECORD		DR	CHK	APP.	DATE	PART NO.		MG634870
DR.	CJH	2009.08.19	CHK.	<i>YH</i>		8/20	PART NAME		
CHK.			APP.	<i>YH</i>		8/20	187 P-LOCK FLAG 2F HSG(CHINGE)		