



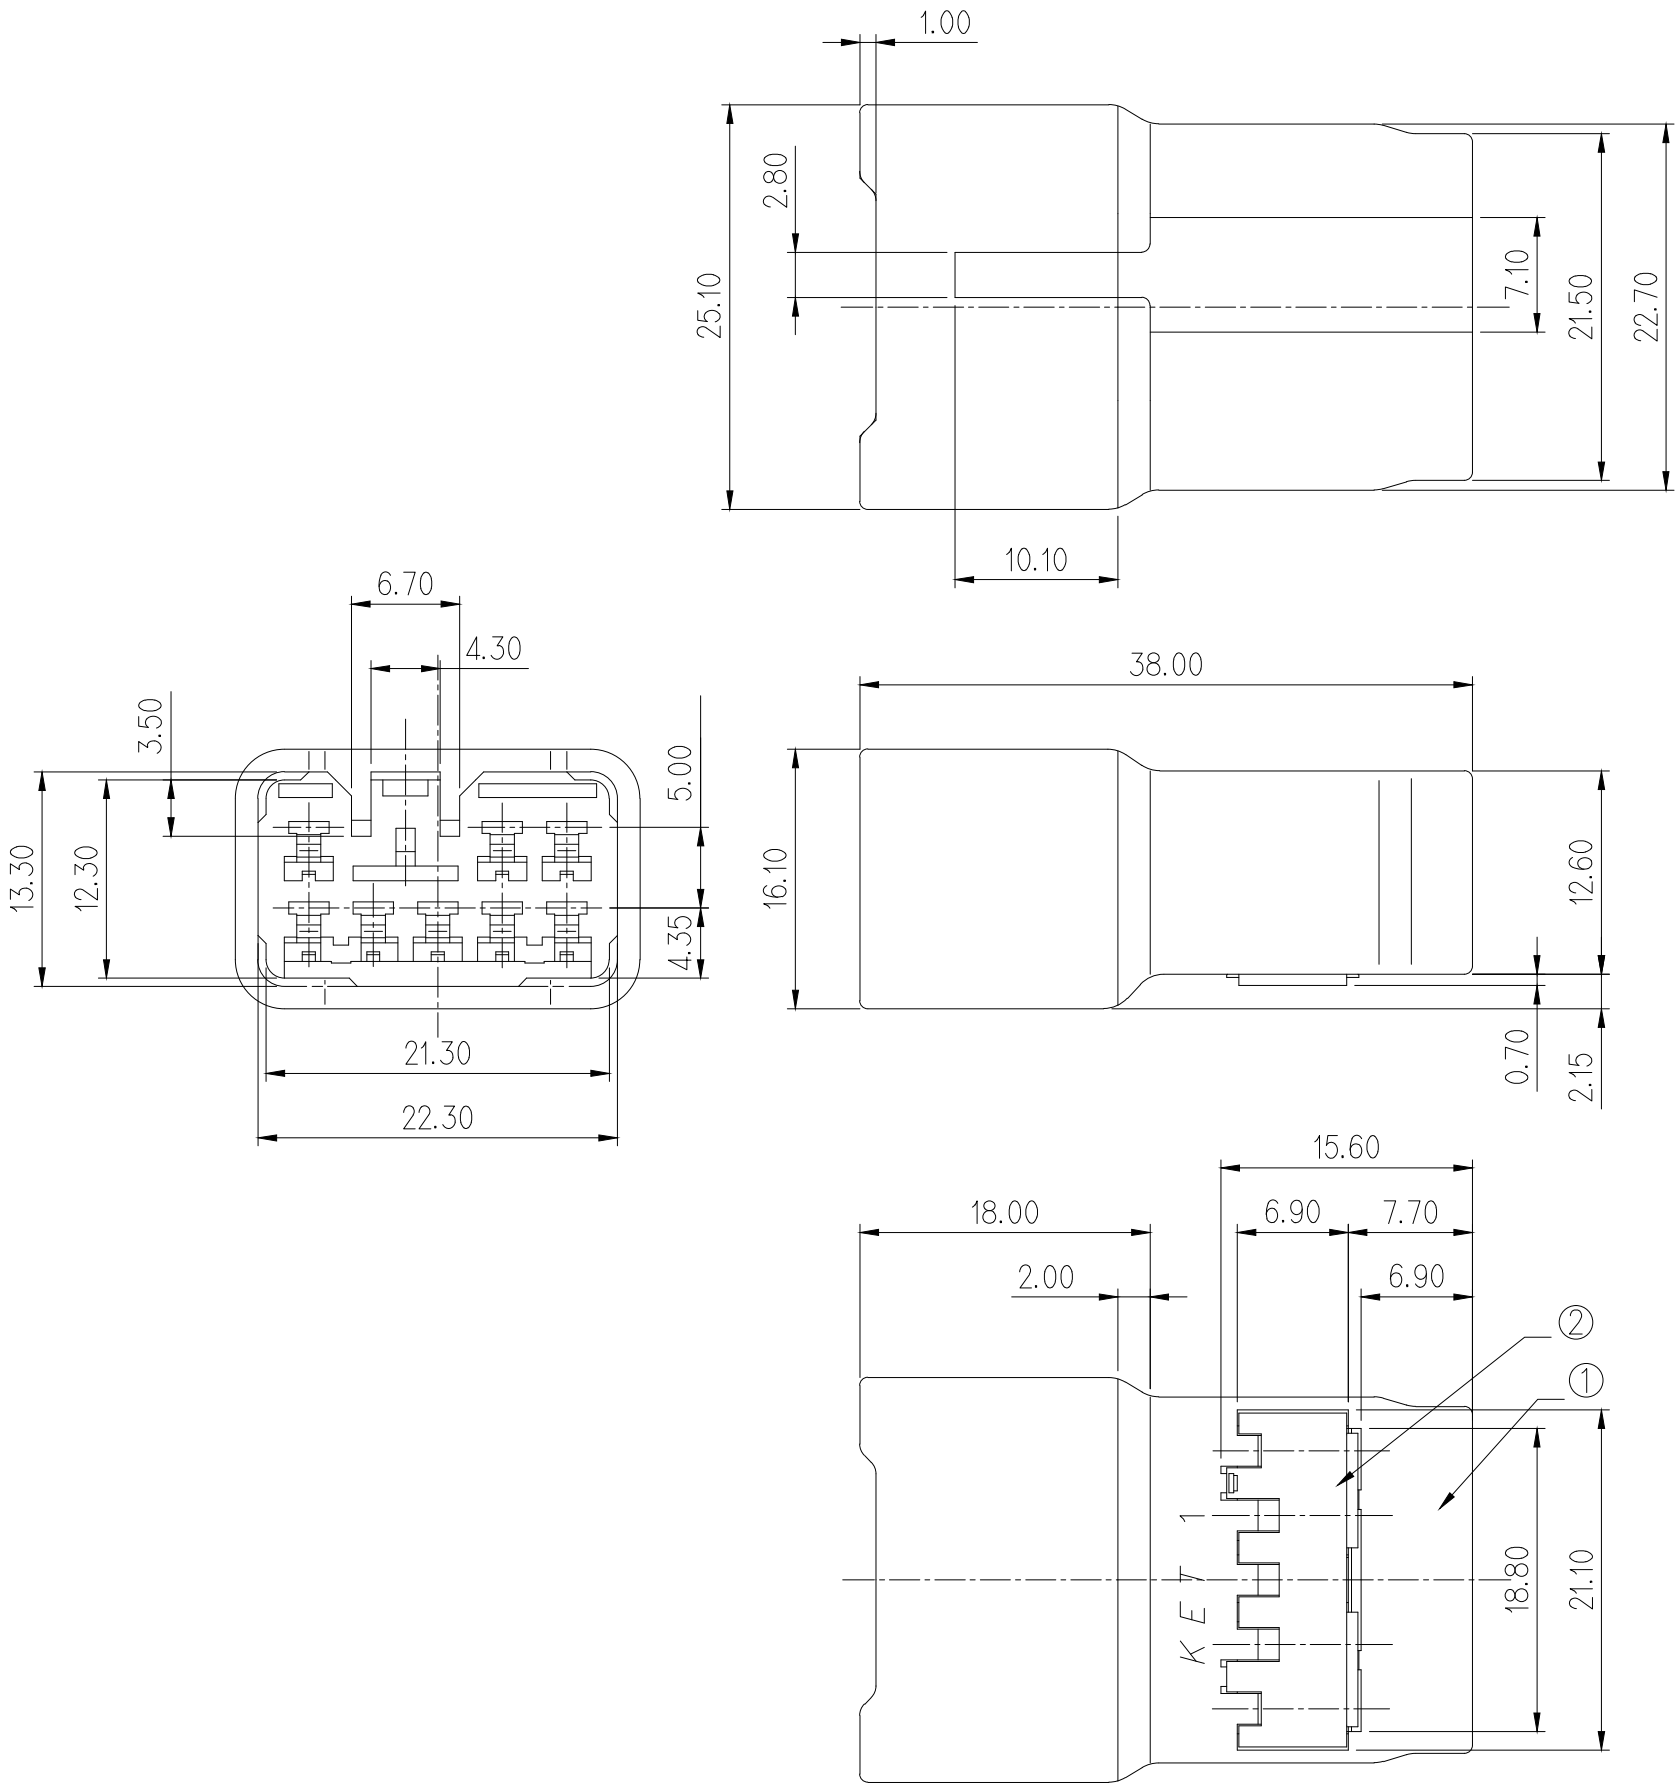

NO	PART NO	PART NAME	MATERIAL	FINISH
①	MG672439	090 II 8P REC. HS'G(NON CLIP)	PBT	NATURAL
②	MG671052	090 II 8P REC. HS'G SPACER	PBT	NATURAL

주 기

- 제품기능상 유해한 BURR, 변형 및 WELDLINE등이 없을 것.
- 적용 TERMINAL : ST740672,673,674
- 적용 HS'G : MG651050
- SPACER는 본 도면과 같이 1차 LOCK'G 상태로 유지, 공급 할것.
- 제품내 함유된 6대 유해물질 (납, 수은, 카드뮴, 6가 크롬, PBBs, PBDEs)은 EU ELV 지침 및 RoHS 법규에서 지정한 최대 허용 농도를 초과해서는 안된다.

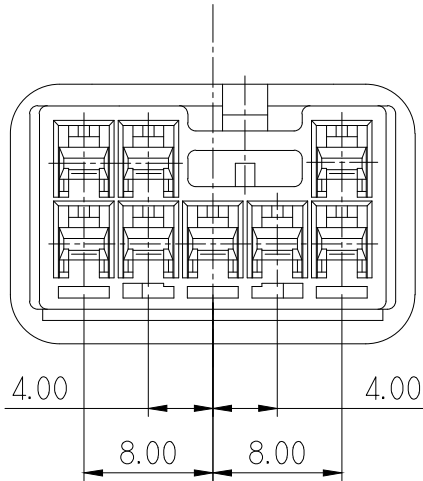

NOTE

- MUST BE FREE OF BURR, WELDLINE AND IMPERFECTION THAT AFFECT FUNCTION.
- APPLICABLE TERMINAL : ST740672,673,674
- APPLICABLE HS'G : MG651050
- SPACER MUST BE KEEP AND SUPPLY FIRST LOCKING CONDITION AS THIS DRAWING
- 6 HAZARDOUS SUBSTANCES IN PARTS (LEAD, MECURY, CADMIUM, HEXAVALENT CHROMIUM, PBDEs) SHALL NOT EXCEED THE MAXIMUM PERMISSIBLE CONCENTRATION PRESCRIBED UNDER EU ELV DIRECTIVE & RoHS REGULATION.

						MATERIAL		SEE TABLE	 KOREA ELECTRIC TERMINAL CO., LTD.		
						FINISH		SEE TABLE			
						WIRE RANGE			CLASS		
						INSULATION			TYPE		
LTR	REVISION RECORD		DR.	CHK.	APP.	DATE	TOLERANCE EXCEPT AS NOTED	SEE TABLE	SCALE 2/1	PART NO.	MG642450
DR. KYM. 01.05.03			CHK. KKJ			PART NAME					090 II 8P REC. ASS'Y (NON CLIP)
CHK.			APP. CHOSH								

GENERAL TOLERANCE (HOUSING)					USED ON
10MAX	20MAX	45MAX	ANGLE	ECCENT	
±0.2	±0.25	±0.3	±30'	0.1	

APPROVED

2018-12-07

KOREA ELECTRIC
TERMINAL CO., LTD.
Korea Electric Te
rminal Co., LTD.

ISSUE MARK

KET KOREA ELECTRIC
ENGINEERED TERMINAL CO., LTD.