
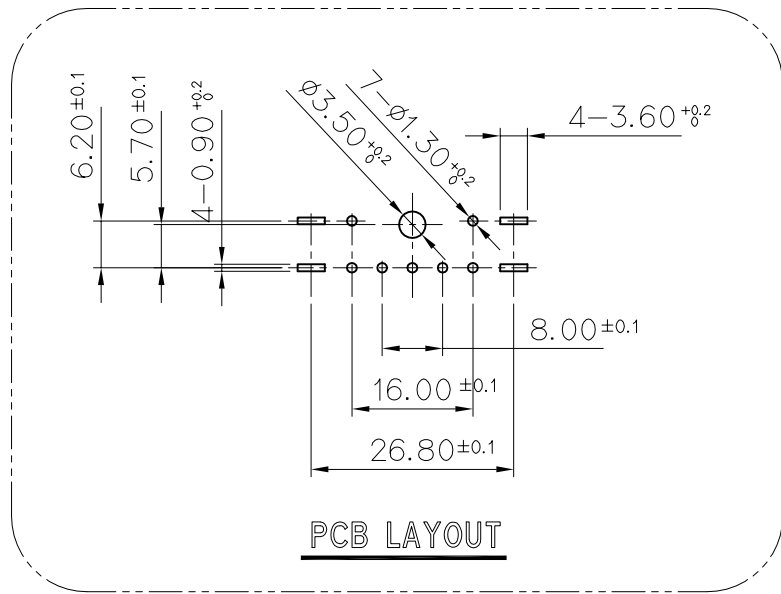
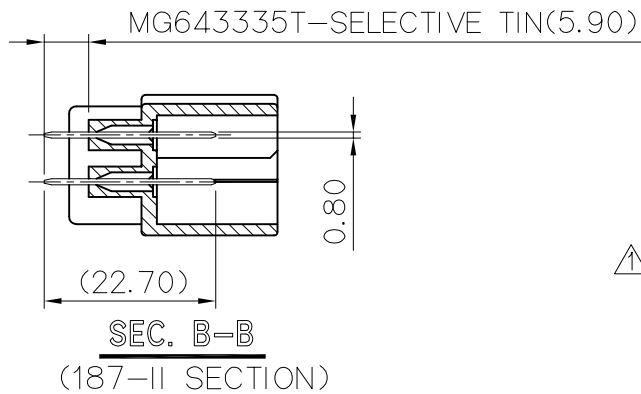
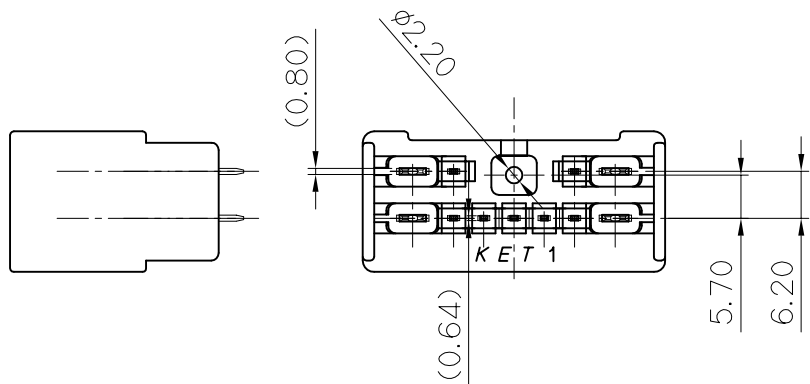
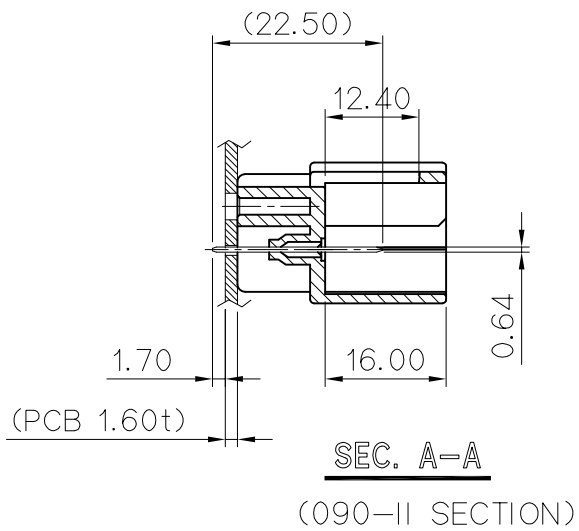


GENERAL TOLERANCE (TERMINAL)					GENERAL TOLERANCE (HOUSING)								USED ON
10MAX	20MAX	45MAX	ANGLE	ECCENT	10MAX	50MAX	100MAX	250MAX	250VR	ANGLE	ECCENT		
±0.2	±0.25	±0.3	±30'	0.1	±0.2	±0.3	±0.55	±0.95	±1.4	±30'	0.1		

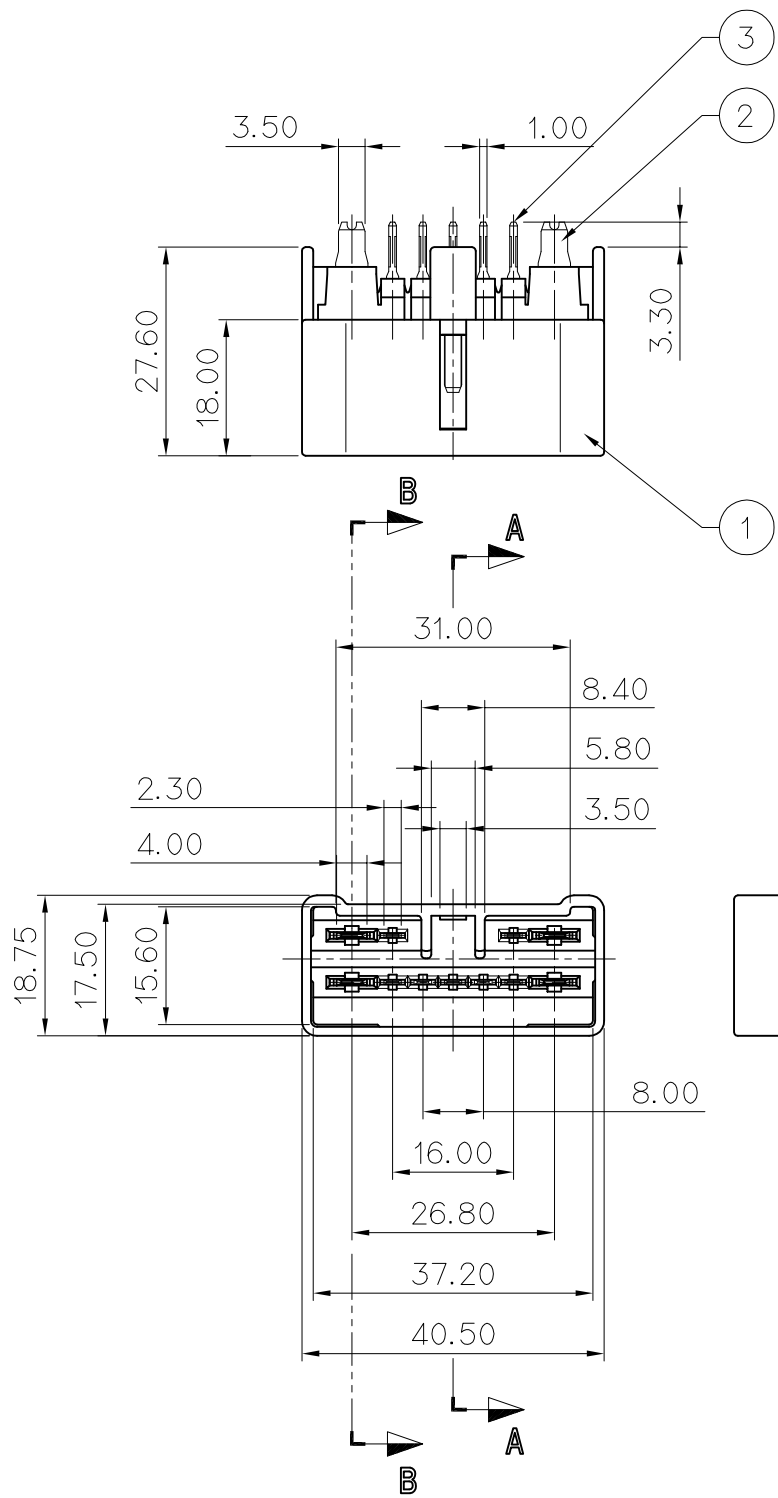

주 기

- 지시하지 않은 반경 R은 0.3로 한다
- 기능상 유해한 BURR, WELDLINE 및 미성형 등이 없을것.
- 적용 FEMALE HOUSING : MG651525
- 제품내 함유된 6대 유해물질 (납,수은,카드뮴,6가크롬, PBBs,PBDEs)은 EU ELV지침 및 RoHS 법규에서 지정한 최대허용농도를 초과해서는 안된다.

NOTE

- UNLESS OTHERWISE SPECIFIED ALL R TO BE 0.3 RADIUS.
- MUST BE FREE OF FLASH, WELDLINE AND IMPERFECTION THAT AFFECT FUNCTION.
- APPLICATION FEMALE HOUSING : MG651525
- 6 HAZARDOUS SUBSTANCES IN PARTS (LEAD,MERCURY, CADMIUM,PBBs,PBDEs,HEXAVALENT CHROMIUM) SHALL NOT EXCEED THE MAXIMUM PERMISSIBLE CONCENTRATION PRESCRIBED UNDER EU ELV DIRECTIVE & RoHS REGULATION.

NO.	PART NAME	PART NO.	ASSEMBLY
1	1809 11M PCB ASSY(VRT-B TYPE)	MG643335	① + ② + ④
2		MG643335T	① + ③ + ⑤

NO.	PART NAME	MATERIAL	FINISH	Q'TY
①	1809 PCB 11P MALE HS'G (VRT-B TYPE)	PBT	NATURAL	1 EA
②	187-II PCB TAB TERMINAL (VRT)	BRASS	PRE-TIN	4 EA
③		BRASS	PRE-TIN + SELECTIVE TIN	4 EA
④	090-II PCB TAB TERMINAL (M)	BRASS	PRE-TIN	7 EA
⑤		BRASS	PRE-TIN + SELECTIVE TIN	7 EA

					MATERIAL SEE TABLE		 KOREA ELECTRIC TERMINAL CO., LTD.	
					FINISH SEE TABLE			
					WIRE RANGE			
					INSULATION			
	설/변(S100195)근거	CYJ		'10.07.28			CLASS 1809	
LTR	REVISION RECORD	DR.	CHK.	APP.	DATE	TOLERANCE EXCEPT AS NOTED SEE TABLE	SCALE 1/1	PART NO.  MG643335,3335T
DR. JIN 2004.07.19		CHK. BIN 2004.07.19		PART NAME				
CHK. K.J.KIM 2004.07.19		APP. C.H.KIM 2004.07.19		1809 11P PCB MALE HS'G ASS'Y (VRT-B)				

ISSUE MARK

KOREA ELECTRIC TERMINAL CO., LTD.

CLASS 1809

TYPE HYBRID

PART NO. MG643335,3335T