


GENERAL TOLERANCE (HOUSING)					USED ON
10MAX	20MAX	45MAX	ANGLE	ECCENT	
±0.20	±0.25	±0.30	±30'	0.10	

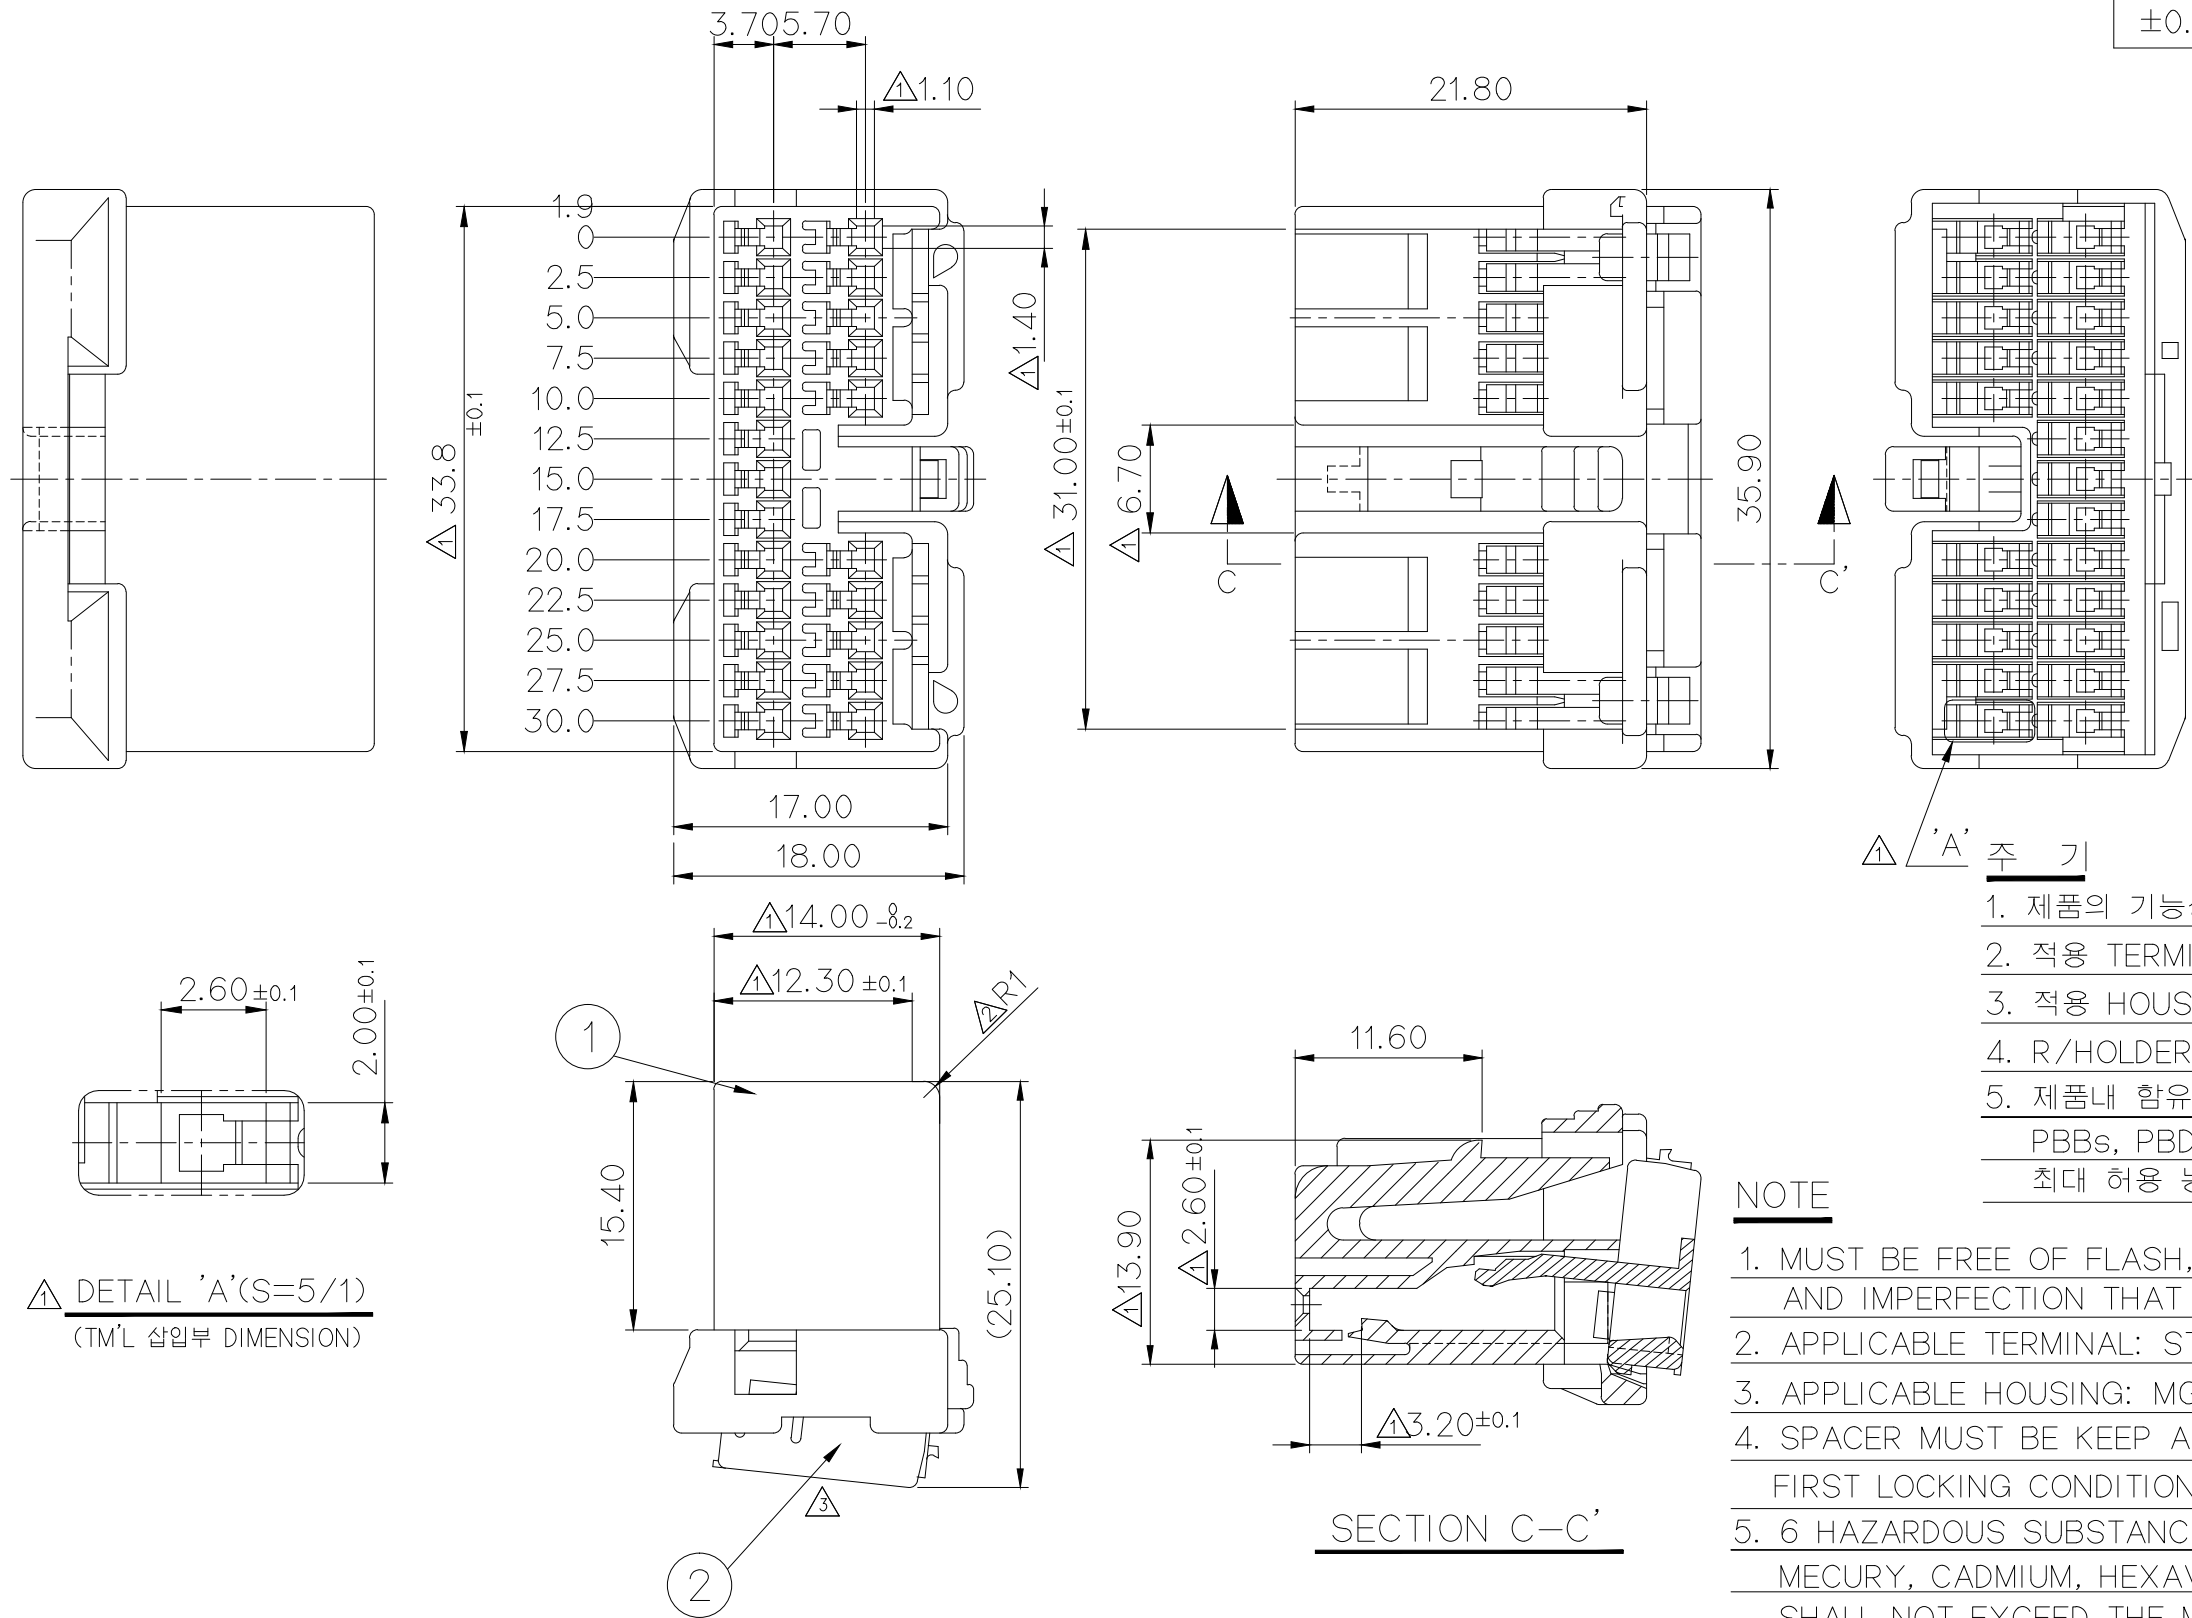

△ 'A' 주 기

1. 제품의 기능상 유해한 WELDLINE, 변형 및 WELDLINE등이 없을 것.
2. 적용 TERMINAL: ST730751.
3. 적용 HOUSING: MG641560.
4. R/HOLDER를 본 도면과 같이 1차 LOCK'G상태로 유지,공급할 것.
5. 제품내 함유된 6대 유해물질 (납, 수은, 카드뮴, 6가 크롬, PBBs, PBDEs)은 EU ELV 지침 및 RoHS 법규에서 지정한 최대 허용 농도를 초과해서는 안된다.

NOTE

1. MUST BE FREE OF FLASH, WELDLINE AND IMPERFECTION THAT AFFECT FUNCTION.
2. APPLICABLE TERMINAL: ST730751.
3. APPLICABLE HOUSING: MG641560.
4. SPACER MUST BE KEEP AND SUPPLY FIRST LOCKING CONDITION AS THIS DRAWING
5. 6 HAZARDOUS SUBSTANCES IN PARTS (LEAD, MECURY, CADMIUM, HEXAVALENT CHROMIUM, PBDEs) SHALL NOT EXCEED THE MAXIMUM PERMISSIBLE CONCENTRATION PRESCRIBED UNDER EU ELV DIRECTIVE & RoHS REGULATION.

APPROVED

2018-12-07

KOREA ELECTRIC
TERMINAL CO., LTD.
Korea Electric Te
rminal Co., LTD.

ISSUE MARK

NO.	PART NAME	PART NO.	MATERIAL	FINISH
1	050 23F HOUSING	MG671561	PBT	NATURAL
2	050 23F REAR HOLDER	MG671562	PBT	BROWN

					MATERIAL	SEE TABLE	 KOREA ELECTRIC TERMINAL CO., LTD.
					FINISH	SEE TABLE	
③	시방변경"030125"의거 도면 재작성	KYM KKJ	JJH	'03,06,24	WIRE RANGE		CLASS
②	시방변경"010177"의거 도면 재작성	LSY KKJ	JJH	'01,10,22	INSULATION		TYPE
①	고객 요청에 의한 치수추가	OJM KKJ	JJH	'00,11,09			
LTR	REVISION RECORD	DR. CHK	APP.	DATE	TOLERANCE EXCEPT AS NOTED	SCALE 2/1	PART NO. MG651563
DR. W.K. CHOI 98.08.31		CHKKKJ		'98,09,04	PART NAME		
CHK.		APP.CHOSH		09,05	050 23P PLUG HS'G ASS'Y		

KET KOREA ELECTRIC
ENGINEERED TERMINAL CO., LTD.