



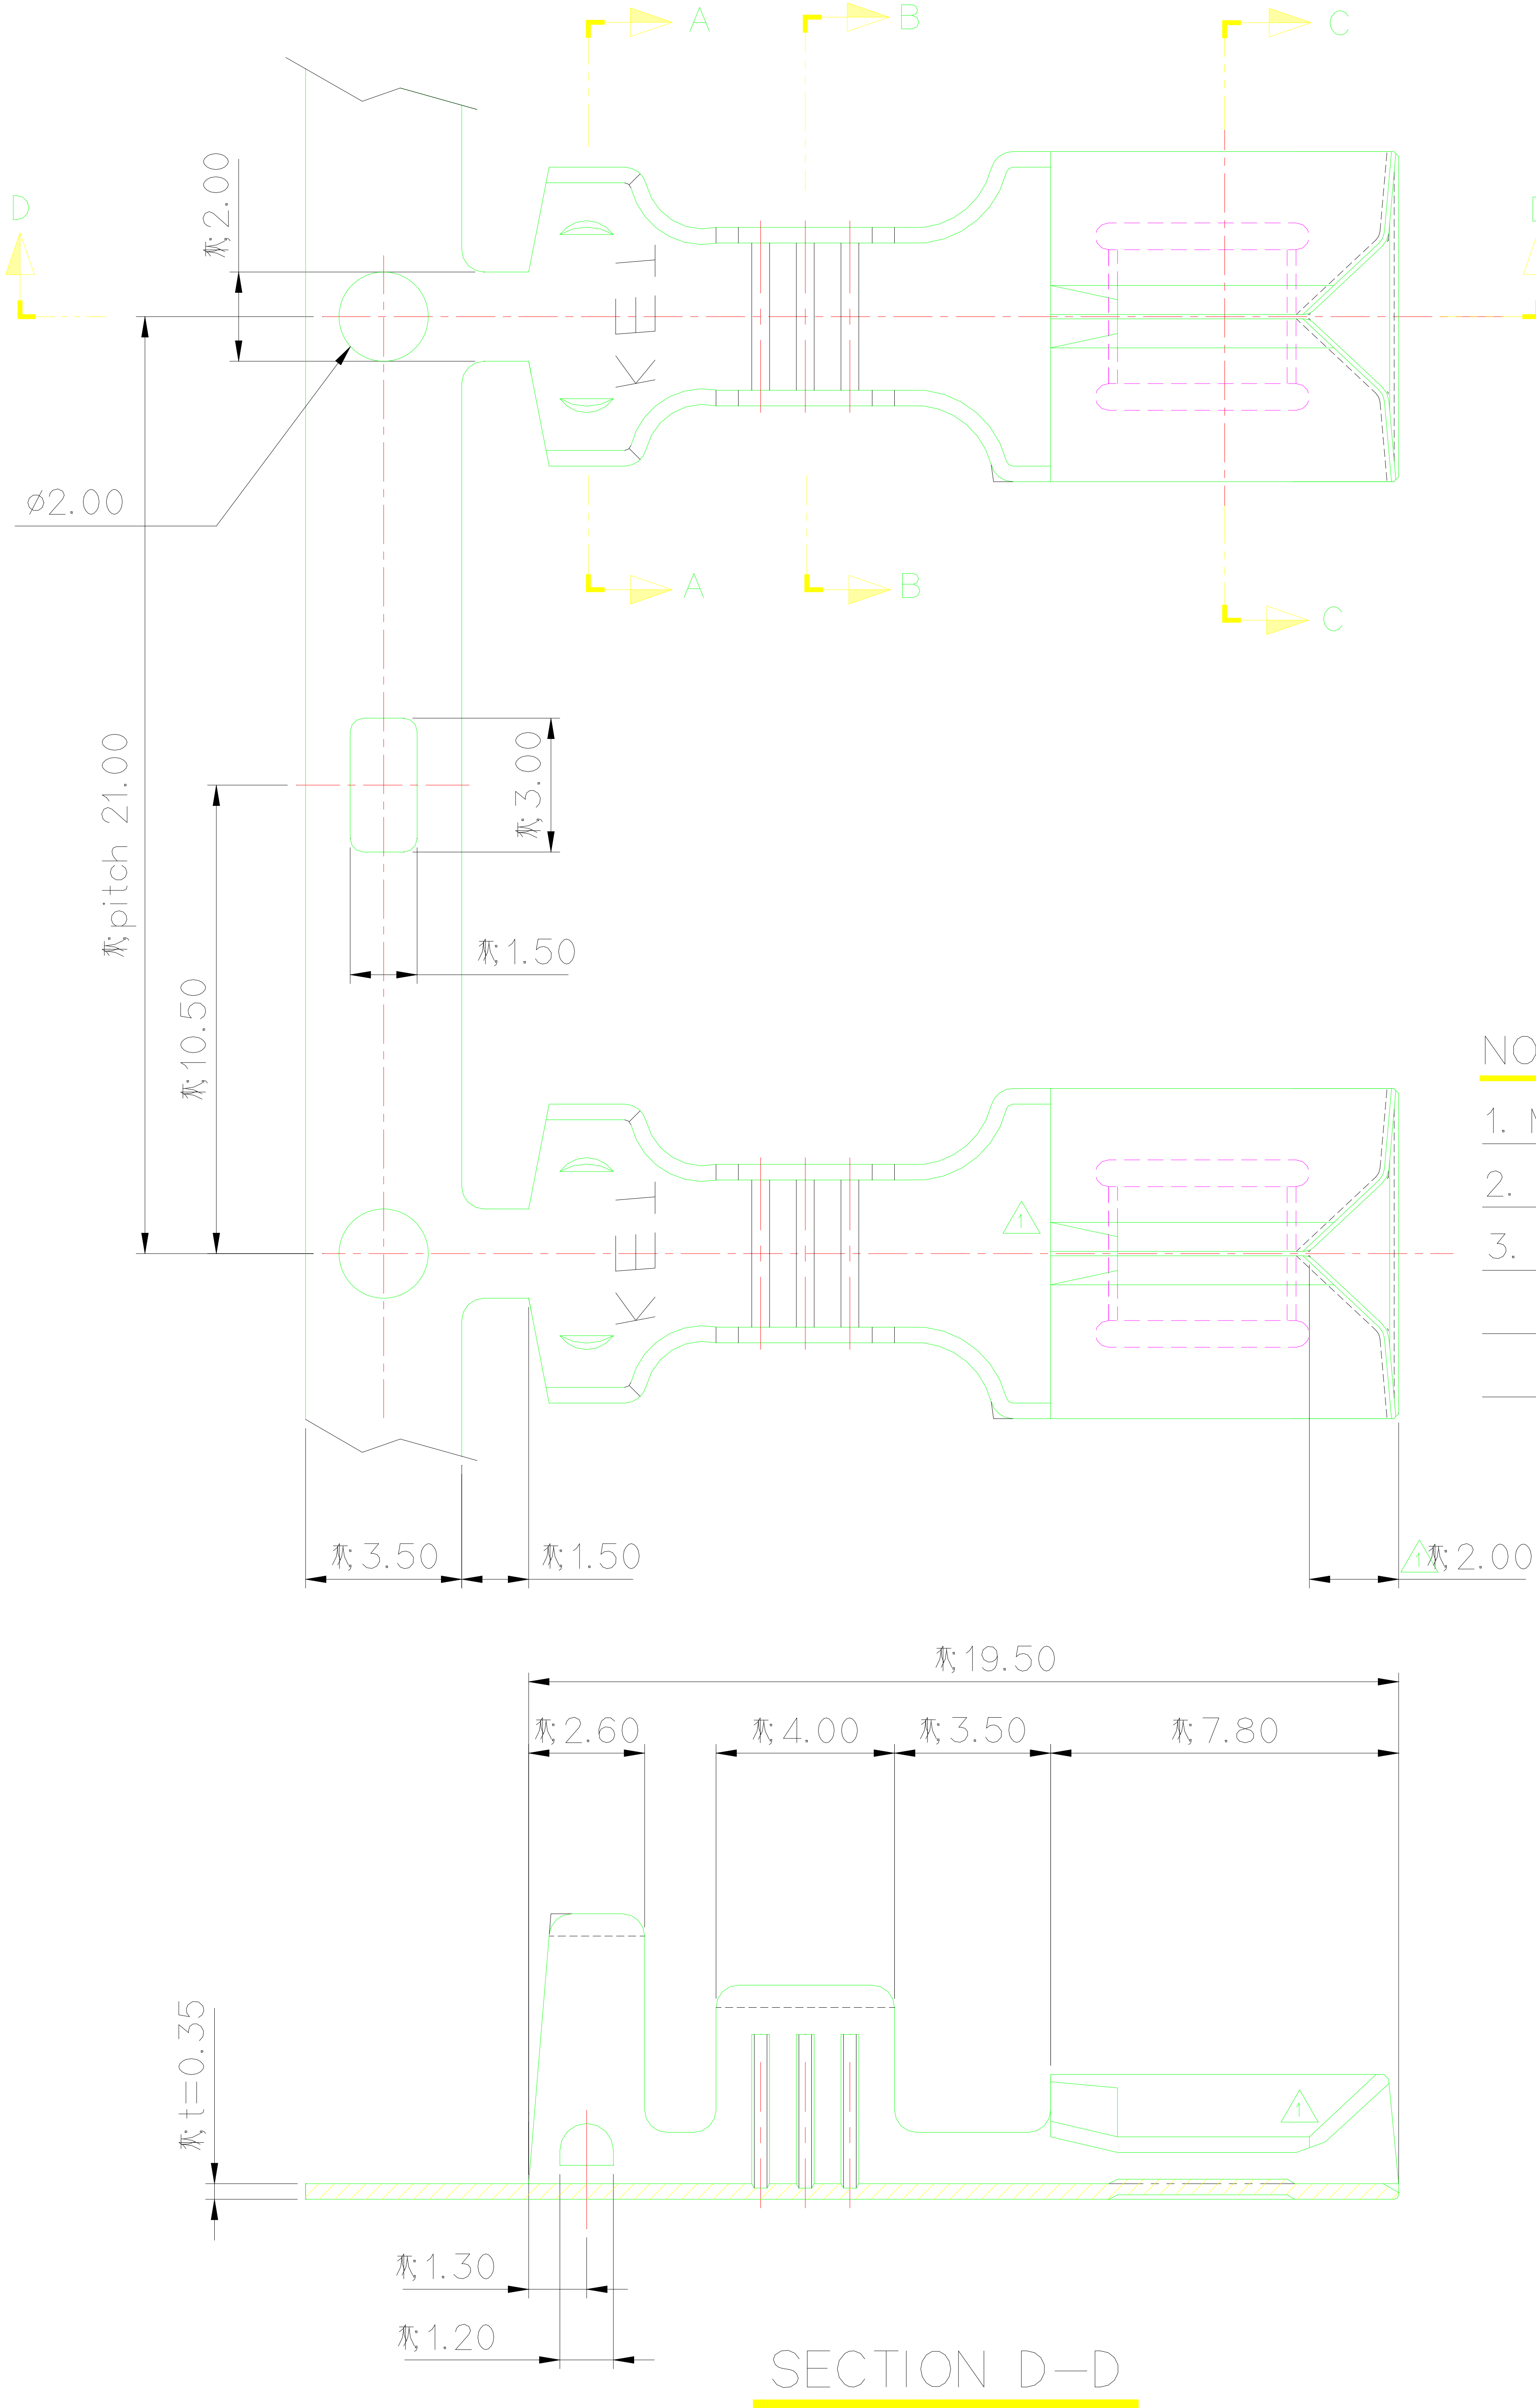


NOTE


- MUST BE FREE OF FLASH, CRACK AND IMPERFECTION THAT AFFECT FUNCTION.
- APPLICABLE HS'G : FUSE & RELAY BOX
- 6 HAZARDOUS SUBSTANCES IN PARTS (LEAD, MERCURY, CADMIUM, HEXAVALENT CHROMIUM, PBBs, PBDEs) SHALL NOT EXCEED THE MAXIMUM PERMISSIBLE CONCENTRATION PRESCRIBED UNDER EU ELV DIRECTIVE & RoHS REGULATION.

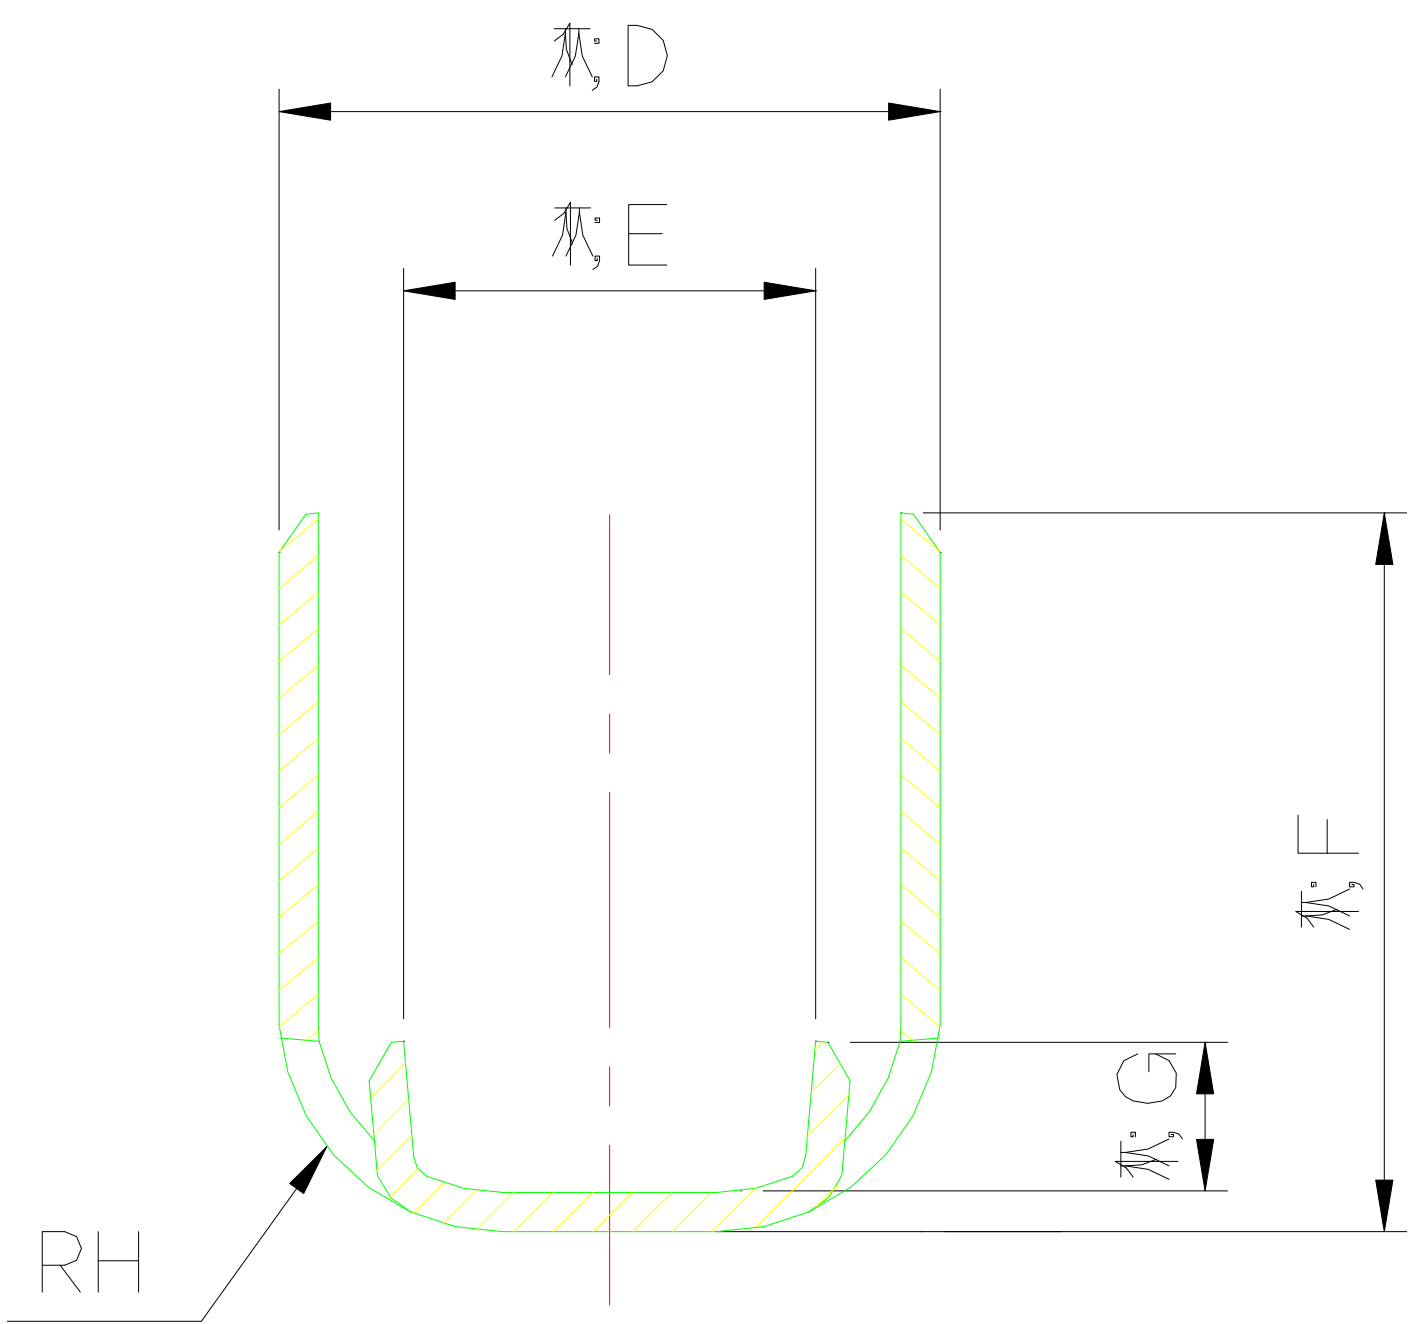

SECTION A-A

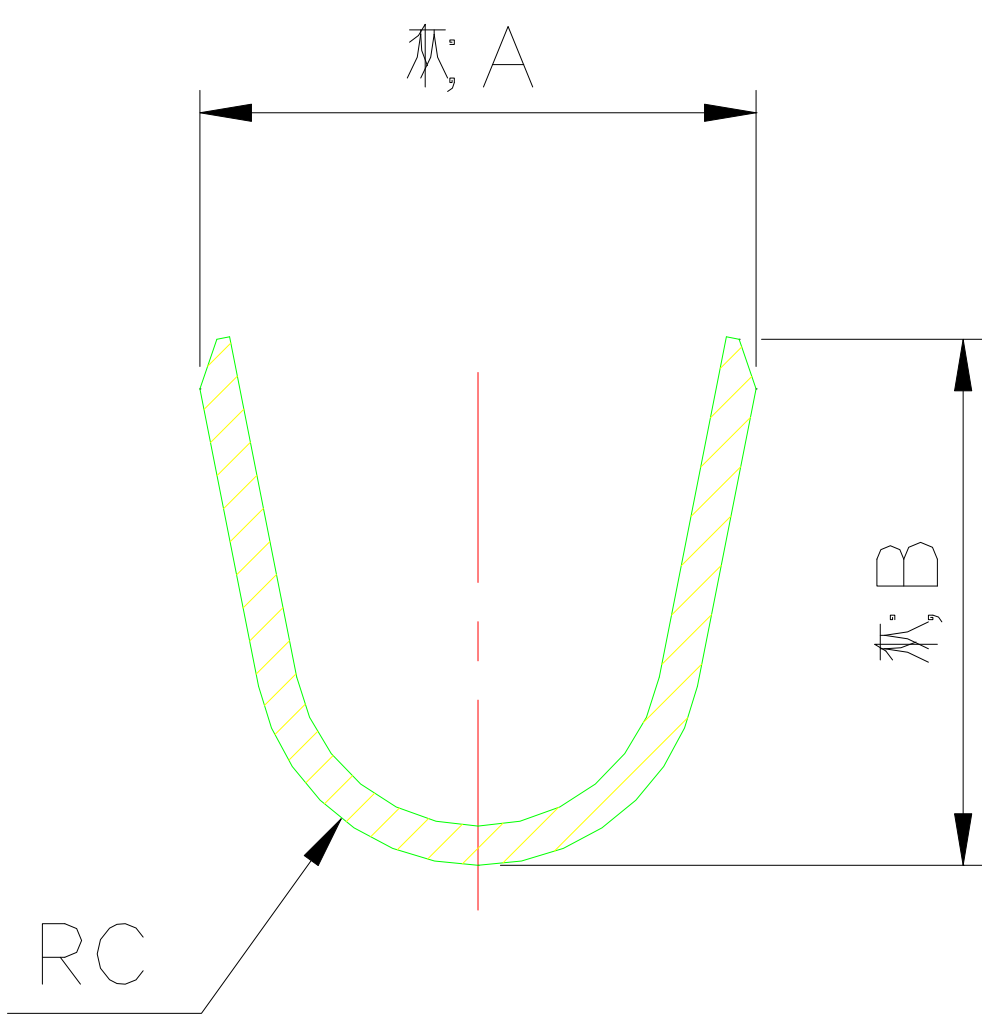

SECTION B-B

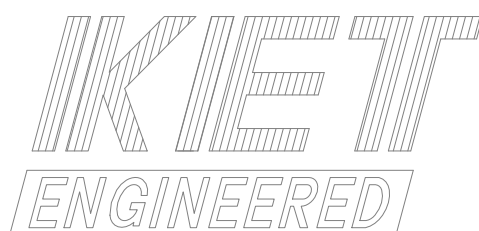					MATERIAL	Copper Alloy	 KOREA ELECTRIC TERMINAL CO.,LTD.			
					FINISH	Pre-Tin				
					WIRE RANGE			CLASS		
					INSULATION			TYPE 250		
	설계사양변경통보서(S100220)근거 제작성		KMH		10.09.10					
LTR	REVISION RECORD		DR.	CHK.	APP.	DATE	TOLERANCE EXCEPT AS NOTED	SEE TABLE	SCALE 5/1	PART NO. ST731165-3,1166-3,1167-3
DR. KMH 09.07.30			CHK.				PART NAME 250 FEMALE TERMINAL(S, M, L)			
CHK.			APP. 7/30							