

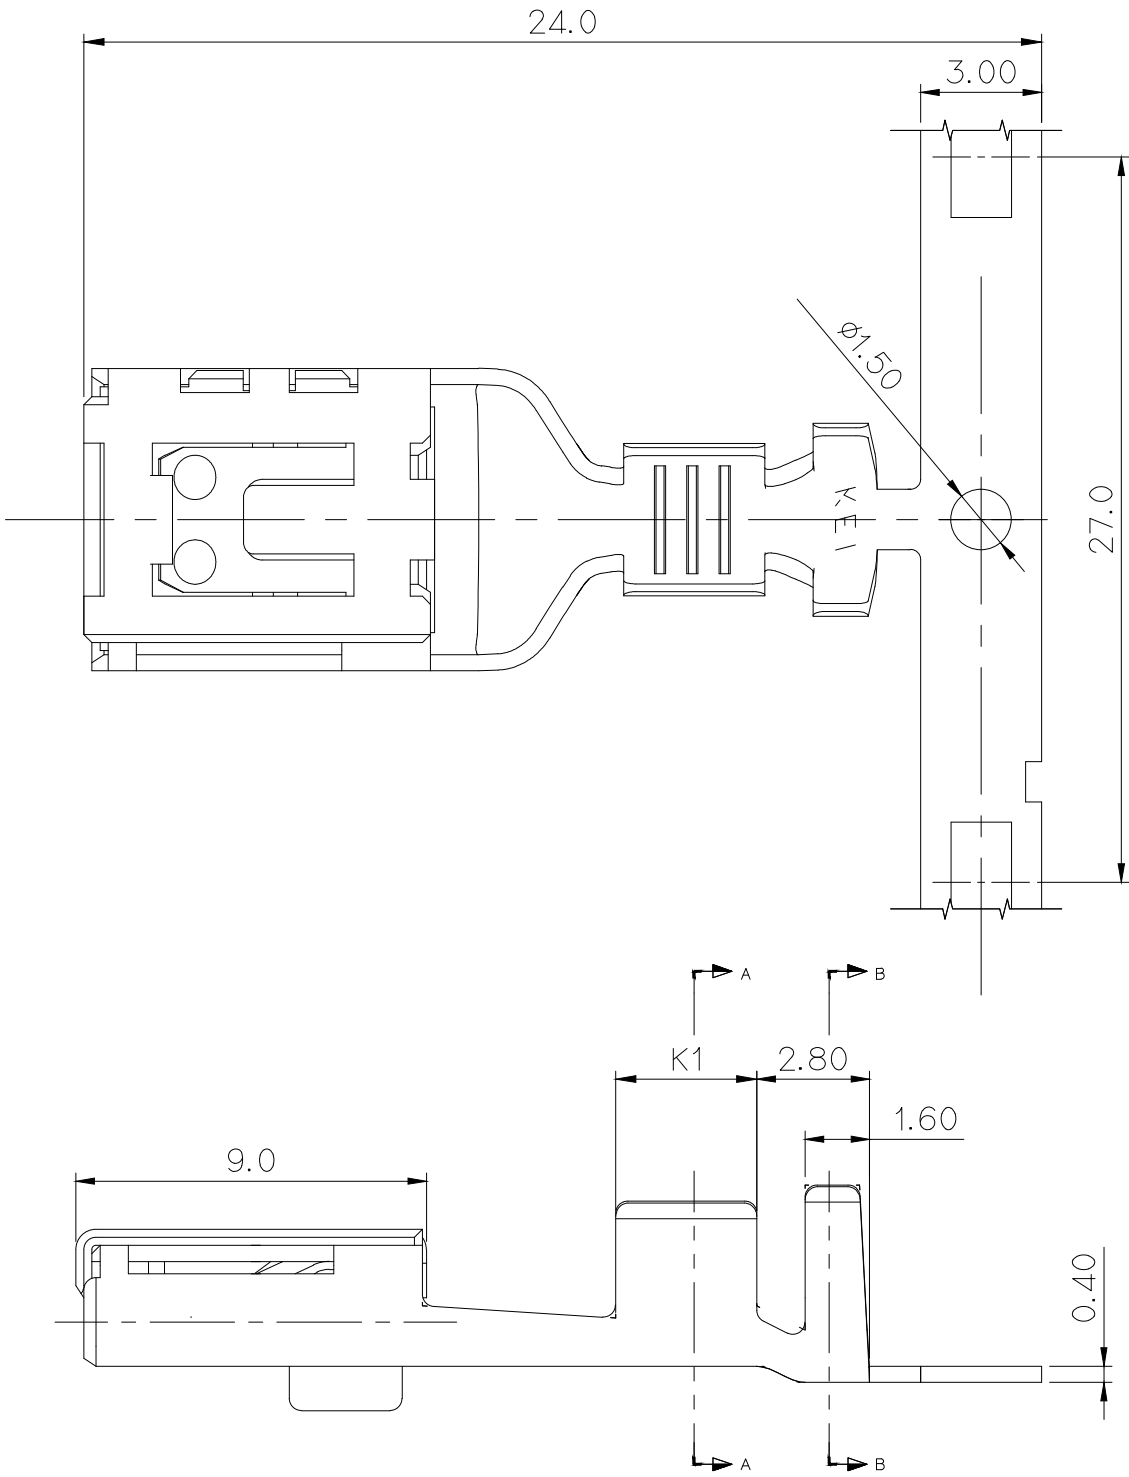


BARREL PART NO.	WIRE RANGE	L1	L2	W1	W2	R1	R2	K1	DIE NO.
ST731209-3	AVS,FLRY 2.5~4.0	4.8	5.7	4.8	5.7	R1.2	R1.65	4.0	11053
ST731210-3	AVS 1.0~2.0	3.65	4.9	3.55	4.8	R0.8	R1.3	3.5	11053-1
ST731211-3	AVS 0.5~0.85	3.0	4.1	2.8	3.9	R0.55	R0.9	3.0	11053-2

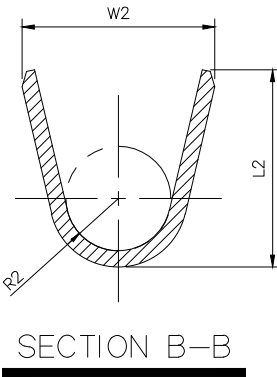

GENERAL TOLERANCE (TERMINAL)					USED ON
10MAX	20MAX	45MAX	ANGLE	ECCENT	
±0.2	±0.25	±0.3	±30'	0.1	

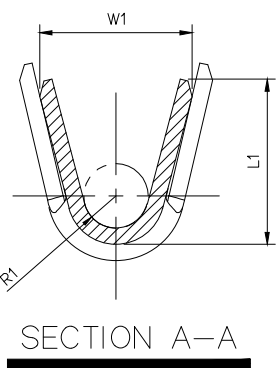

주 기

- 1. 기능상 유해한 BURR 및 WELDLINE등이 없을 것.
- 2. 적용 상대 MALE TERMINAL : ST741206,ST741207,ST741208
- 3. 제품내 함유된 6대 유해물질 (납, 수은, 카드뮴, 6가크롬, PBBs, PBDEs)은 EU ELV 지침 및 RoHS 법규에서 지정한 최대 허용 농도를 초과해서는 안된다.

NOTE

- 1. MUST BE FREE OF FLASH, SINK AND IMPERFECTION THAT AFFECT FUNCTION.
- 2. APPLICABLE MALE TERMINAL : ST741206,ST741207,ST741208
- 3. 6 HAZARDOUS SUBSTANCES IN PARTS (LEAD,MERCURY,CADMIUM HEXAVALENT CHROMIUM,PBBs,PBDEs) SHALL MAXIMUM PERMISSIBLE CONCENTRATION PRESCRIBED UNDER EU ELV DIRECTIVE & RoHS REGULATION.

APPROVED

2016-03-09

KOREA ELECTRIC
TERMINAL CO., LTD.
Product Development Team 1

ISSUE MARK

							MATERIAL		COPPER-ALLOY	 KOREA ELECTRIC TERMINAL CO., LTD.
							FINISH		PRE-TIN	
							WIRE RANGE		SEE TABLE	
							INSULATION		SEE TABLE	
LTR	REVISION RECORD		DR.	CHK.	APP.	DATE	TOLERANCE EXCEPT AS NOTED		SCALE 5/1	PART NO.
DR.	YSW	'11.12.27	CHK.				SEE TABLE		5/1	SEE TABLE
CHK.	HEM	'11.12.27	APP.	HSH	'11.12.27		630(250) FEMALE TERMINAL(L),(M),(S)			