
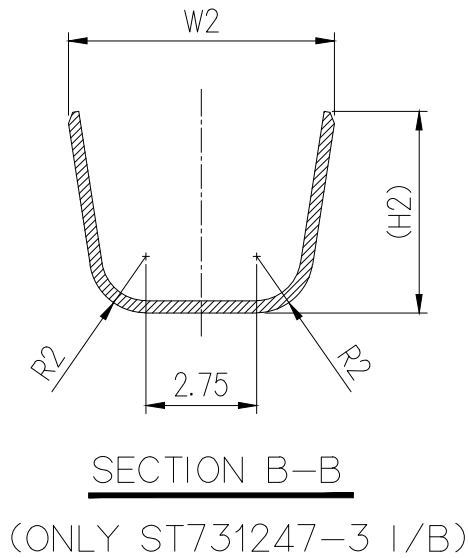
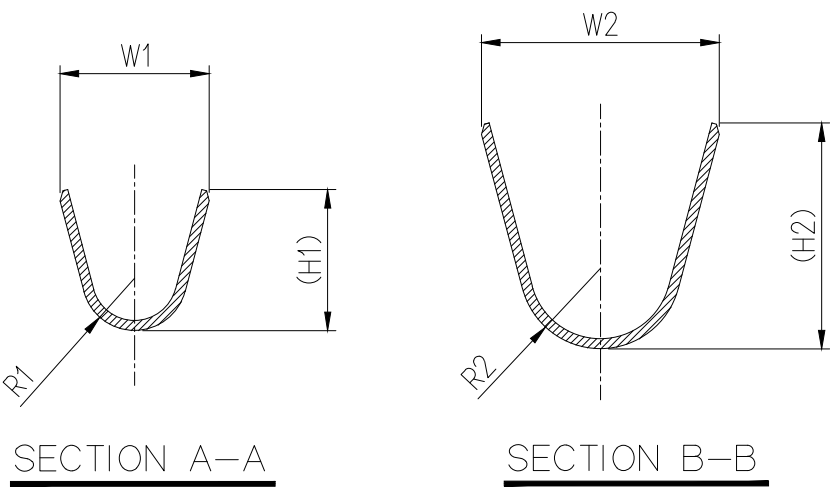


NO.	PART NO.	W1	(H1)	R1	W2	(H2)	R2	A	B	WIRE RANGE(mm ²)	REMARK<외경>
1	ST731245-3	2.30	2.50	0.80	4.20	4.25	1.65	3.40	1.60	0.53~0.86 (UL1015)	φ2.50~φ2.75
2	ST731246-3	3.60	3.40	1.20	5.00	5.10	2.00			1.38~2.18 (UL1015)	φ3.10~φ3.30
3	ST731247-3	4.60	3.10	1.40	6.60	5.00	1.40	3.20	1.80	0.53+0.53 (UL1015) 0.86+0.86 (UL1015)	φ2.50+φ2.50 φ2.75+φ2.75

GENERAL TOLERANCE (TERMINAL)						USED ON
10 MAX	20 MAX	45 MAX	45 VR	ANGLE	ECCENT	
±0.2	±0.25	±0.3	±0.5	±30'	0.1	

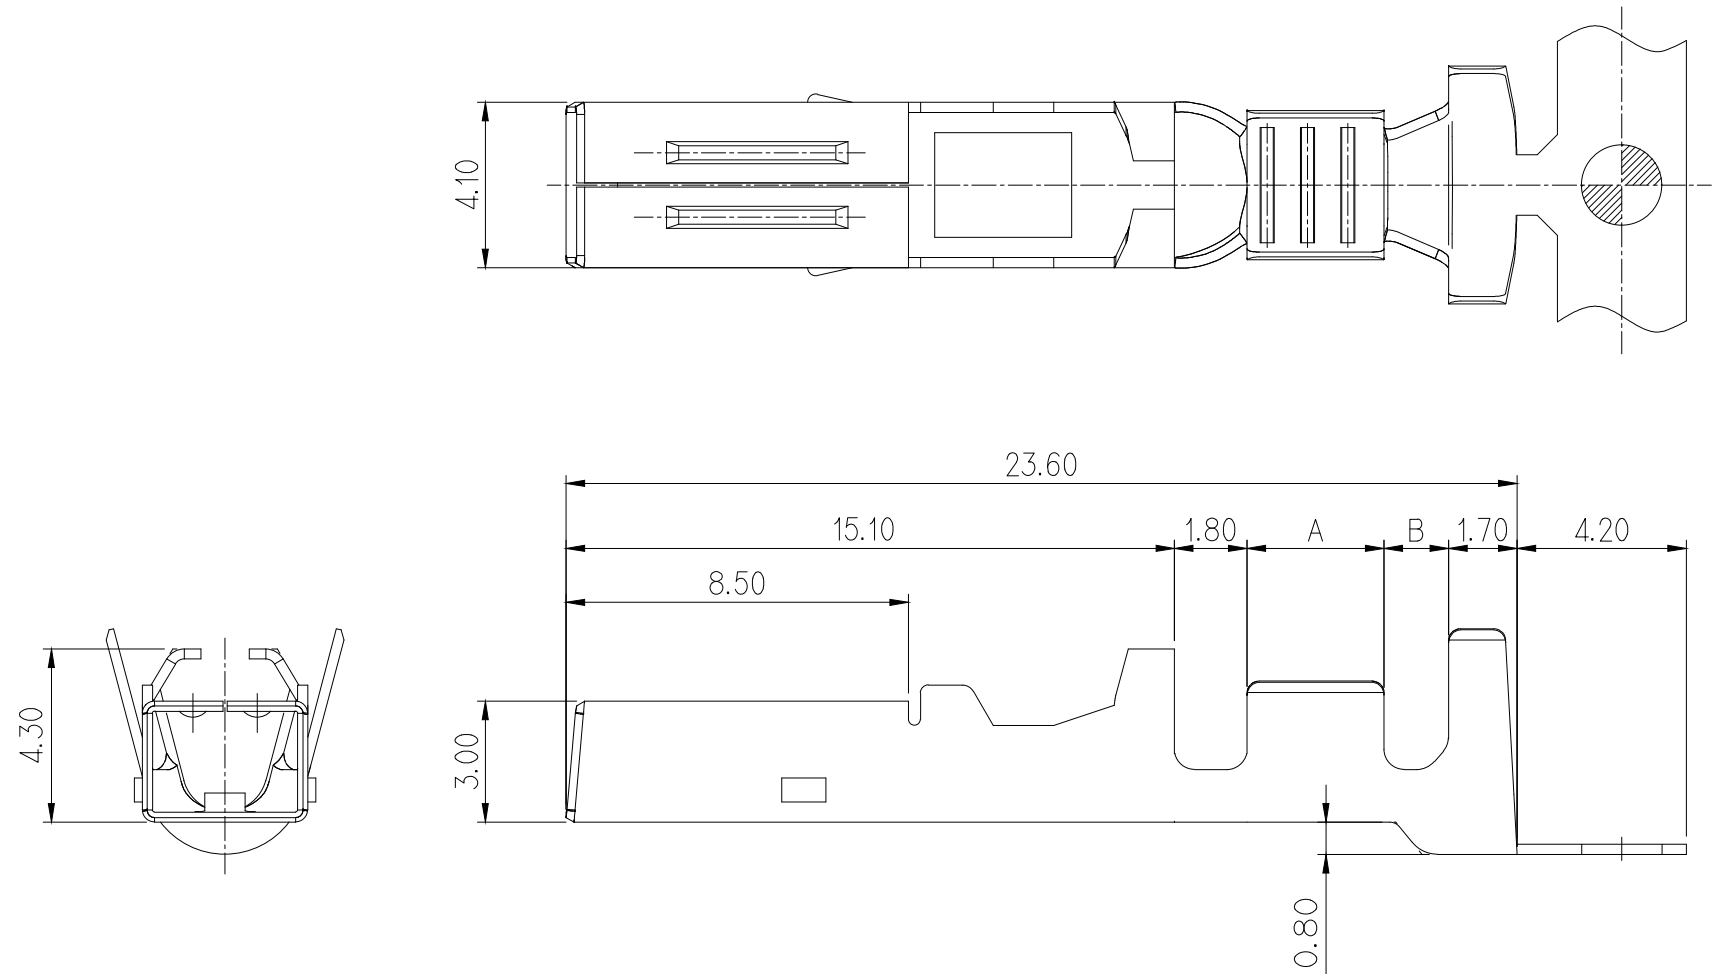

NOTE

- UNLESS OTHERWISE SPECIFIED ALL RADII TO BE 0.3 RADIUS.
- MUST BE FREE OF FLASH, SINK AND IMPERFECTION THAT AFFECT FUNCTION.
- APPLICABLE HOUSING : MG615042
- APPLICABLE TAB TERMINAL : ST741248,49,50
- 6 HAZARDOUS SUBSTANCE IN PARTS (LEAD,MERCURY,CADMIUM HEXAVALENT CHROMIUM,PBBs,PBDEs) SHALL NOT EXCEED THE MAXIMUM PERMISSIBLE CONCENTRATION PRESCRIBED BY THE EU ELV DIRECTIVE & THE ROHS REGULATION..

NOTE

- 지시없는 R=0.30으로 한다.
- 기능상 유해한 흠,변형 및 BURR가 없을것.
- 적용 HOUSING : MG615042
- 적용 상대 TAB. TERMINAL : ST742148,49,50
- 제품내 함유된 6대 유해물질 (납,수은,카드뮴,6가크롬,PBBs PBDEs)은 EU ELV 지침 및 ROHS 법규에서 지정한 최대허용 농도를 초과해서는 안된다.

					MATERIAL Copper Alloy		 KOREA ELECTRIC TERMINAL CO., LTD.		
					FINISH PRE-TIN				
					WIRE RANGE			CLASS NEW 3220	
					INSULATION			TYPE	
LTR	REVISION RECORD		DR.	CHK.	APP.	DATE	TOLERANCE EXCEPT AS NOTED SEE TABLE	SCALE 5/1	PART NO. ST731245,46,47
DR. KSH '10.03.25		CHK.				PART NAME NEW 3220 FEMALE TERMINAL			
CHK.		APP. BUC '10.03.25							

APPROVED

2016-03-11

KOREA ELECTRIC
TERMINAL CO., LTD.
Korea Electric Te
rminal Co., LTD.

ISSUE MARK